Honeywell | Fire Safety

Fire Alarm Control Panel LT-32 / LT-159

Installation and User Manual

M-168.1-SERIE-LT-EN Version 2024 / 06.2024

Intended Purpose

This product may be used only for the applications outlined in the catalogue and in the technical description, and only in conjunction with the recommended and approved external devices and components.
This documentation contains registered and unregistered trademarks. All trademarks are the property of the respective owners. The use of this documentation does not grant you a license or any other right to use any name, logo or label referred to or depicted herein.
This documentation is subject to the copyright of Honeywell. The content must not be copied, published, modified, distributed, transmitted, sold or changed without the express prior written permission of Honeywell.
The information contained in this documentation is provided without warranty.

Safety-related user information

This manual includes information required for the proper use of the products described.
To ensure correct and safe operation of the product, all guidelines concerning its transport, storage, installation, and mounting must be observed. This includes taking the necessary care when operating the product.
The term 'qualified personnel' in the context of the safety information included in this manual or on the product itself designates:

- project engineers who are familiar with the safety guidelines concerning fire alarm and extinguishing systems.
- trained service engineers who are familiar with the components of fire alarm and extinguishing systems and the information on their operation as included in this manual.
- trained installation or service personnel with the necessary qualifications for carrying out repairs on fire alarm and extinguishing systems, or who are authorized to operate, earth and label electrical circuits and/or safety equipment/systems.

Symbols

The following information is provided in the interests of personal safety and to prevent damage to the product described in this manual and all equipment connected to it. Safety information and warnings to prevent hazards endangering the life and health of users and maintenance personnel, as well as causing damage to the equipment itself, are indicated by the following pictograms. Within the context of this manual, these pictograms have the following meanings:

Warning - designates risks for man and/or machine. Non-compliance will result in risks to man and/or machine. The level of risk is indicated by the word of warning.

Note - important information on a topic or a procedure and other important information.

Standards and guidelines - observe configuration and commissioning information in accordance with the national and local requirements.

This symbol precedes information about compliance with standard(s).

Dismantling

In accordance with Directive 2012/19/EU (WEEE), after being dismantled, electrical and electronic equipment is taken back by the manufacturer for proper disposal.

© Honeywell International Inc./technical changes reserved!
This documentation is subject to copyright law and, as per Sections 16 and 17 of the German Copyright Act (UrhG), may be neither copied nor disseminated in any other way. Any infringement as per Section 106 of the UrhG may result in legal action.

Contents

1. GENERAL / APPLICATION 7
1.1 Precautions 8
1.2 CE Marking and Information 9
1.3 National Standards 9
2. TRANSPORT DAMAGE INSPECTION 10
2.1 Pre-installation Check List 11
3. INSTALLATION OVERVIEW 12
4. SPECIFICATIONS 13
4.1 Mechanical Specifications 14
4.2 Electrical Specifications 15
4.3 Environmental Specifications 15
5. PANEL PARTS – FRONT VIEW 16
5.1 Panel parts – Internal View 17
6. PANEL INSTALLATION 19
6.1 Surface Mounting 20
7. CABLING 21
7.1 Cable Routing and Connections 23
7.2 LT-32 / LT-159 Setup and Connections Overview 26
8. DETECTORS AND MODULES OVERVIEW 27
9. DISPLAY AND CONTROLS 28
10. SYSTEM DEFAULT PASSCODE 30
11. DISPLAY OVERVIEW 31
11.1 Display Indications and Buttons 32
12. CONFIGURATION MENU 33

13. PROGRAM MENU 34
13.1 Configuration – Access to Menu 35
13.2 Configuration - Date and Time Setting 36
13.3 Configuration – Panel Configuration 38
13.4 Configuration – Peripherals Options 42
13.5 Configuration – Autoprog 44
13.6 Configuration – Description 45
13.7 Configuration – Matrix / Cause and Effect I/O 47
13.8 Configuration – Activation Delay 50
13.9 Configuration - Activity Log 52
13.10 Configuration – Change Passcode 53
14. OPERATION – ENABLE / DISABLE ZONE AND POINT 54
15. OPERATION – ENABLE / DISABLE SOUNDERS 55
16. SYSTEM STATUS 56
16.1 System Status – Signal and Battery Levels for wireless devices 56
16.2 System Status – Panel Diagnostics Values 58
16.3 System Status – Points Diagnostics Values 59
17. HISTORY LOG 60
18. SYSTEM TEST 61
18.1 System Test – User Interface and Relay 61
18.2 System Test – Zones 62
18.3 System Test – Outputs 63
18.4 System Test – Sounders 64
19. MAINTENANCE 65

20. UPGRADING PANEL FIRMWARE 66
21. PRODUCT LIST 70
21.1 Compatible Devices 70

1. GENERAL / APPLICATION

The purpose of this manual is to provide the user with instructions concerning installation, use and maintenance of the LT-32 / LT-159 Fire Alarm Control Panel (FACP).

SYSTEM EQUIPMENT

The analogue-addressable LT-32 / LT-159 FACP is compact in size and very easy to install and configure. The system is specifically designed for Agile wireless equipment. Installation and commissioning time are reduced to a minimum, since only the physical connection to the wireless system gateway is required allowing the FACP identifies the sensors, input modules, sirens/flashes installed.

LT-32 is a single loop addressable panel, limited to 32 addressable devices, sensors or modules.

LT-159 allows the connection of up to 159 addressable devices, mainly wireless and a few wired ones distributed in a maximum of 16 zones. LT-32 / LT-159 include one sounder circuit.

LT-32 / LT-159 FACP includes Honeywell's Advanced protocol, which maximizes the speed and efficiency of alarm detection, as well as providing maximum information to the installer.

The 4,3" / 109,2 cm (480 x 272 pixel) screen provides an intuitive user interface via its touch screen and menus with quick, and easy system operation. The FACP allows configuration from the screen itself.

Due to its size and power, it is the ideal analogue addressable control panel for small sites, where maximum information is required from the installed devices. The control panel allows the identification of each of the addressable sensors, with different levels of alarm, to verify the state of the system, before carrying out any evacuation or transmission to the alarm receiving station or to the building management system.

Do not try to use the control unit and connected devices without reading this manual!

1.1 Precautions

- These instructions contain procedures to be followed to avoid damage to equipment. It is assumed that the user of this manual has completed a training course and that he knows the applicable rules that are in force.
- The system and all its components must be installed in an environment with the following conditions:
  - Temperature: -5°C ... +40°C.
  - Humidity: 10 % ... 95 % (non-condensing).
- Peripheral devices (sensors, etc.) which are not perfectly compatible with the control unit may cause damage to the control unit or cause the system to malfunction at any time. It is therefore essential to only use material which is guaranteed by Honeywell and is compatible with its control units.
- Please consult Honeywell Technical Service if in any doubt.

- This system, like all solid-state components, may be damaged by induced electrostatic voltages. Handle the boards by the edges and avoid touching the electronic components.
- In any case, appropriate earthing ensures a reduction in sensitivity to disturbances.
- Please consult Honeywell Technical Service if you cannot solve installation problems.
- No electronic system will operate if it is not supplied with power.
- If the mains power supply fails, the system will still operate using battery power, but only for a limited period.
- During the system planning phase, consider the authority required to ensure the power supply and batteries are appropriately dimensioned.
- Skilled personnel must periodically check the condition of batteries.
- Disconnect the MAINS and the batteries BEFORE removing or inserting any board.
- Disconnect ALL power supply sources from the control unit BEFORE performing any servicing.
- The control unit and the connected devices (sensors, modules, repeaters, etc.) may be damaged if a new board is inserted or removed, or if the powered cables are connected.
- The most common cause of malfunctions is inappropriate maintenance.
- Pay particular attention to these aspects from the start of the system planning phase; this will facilitate future servicing and will reduce cost.

1.2 CE Marking and Information

This document is a declaration that the products listed below conform to the essential protection requirements of the following European Directives:

- RoHS - Restrictions on the Use of Certain Hazardous Substances in Electrical and Electronic Equipment
- Equipment Directive 2011/65/EU
- Compliance with RoHS 2 - Product does not contain any hazardous substances above the limits designated in the RoHS Directive. Product falls within Category 9 - Monitoring and Control instruments

The EMC Directive 2014/30/EU, by the application of the following EMC Standards:

- EN 61000-6-3:2007 +A1: 2011 (Emissions)
- Electromagnetic compatibility (EMC) Generic emission standard for residential, commercial and light industrial environments.
- EN 50130-4: 2011 +A1: 2014 (immunity)
- EMC Product family standard: immunity requirements for components of fire, intruder and social alarm systems.
- Low Voltage Directive 2014/35/EU
- CPR Directive 305/2011

1.3 National Standards

- This equipment must be installed and operated in accordance with these instructions and the appropriate national, regional and local regulations, specific to the country and location of the installation. Consult with the appropriate Authority Having Jurisdiction (AHJ) for confirmation of the requirements.
- This equipment must be installed in accordance with these instructions and the appropriate national, regional and local wiring regulations.

This device must be installed and must operate in accordance with these instructions and to the rules in force in the installation place.

EN54

EN54-2 13.7
Maximum of 159 Sensors / Manual Call Points per panel.

Additional and updated information
The described features, specifications and product related information in this manual correspond to the date of issue (refer to date on the front page) and may differ due to modifications and/or amended Standards and Regulations of the System design, Installation and Commissioning.
Updated information is available for comparison on the MORLEY IAS Fire Systems homepage.

2. TRANSPORT DAMAGE INSPECTION

Please check all the packaging and components for damage before commencing the assembly and installation work. Do not assemble or install visibly damaged modules and components!

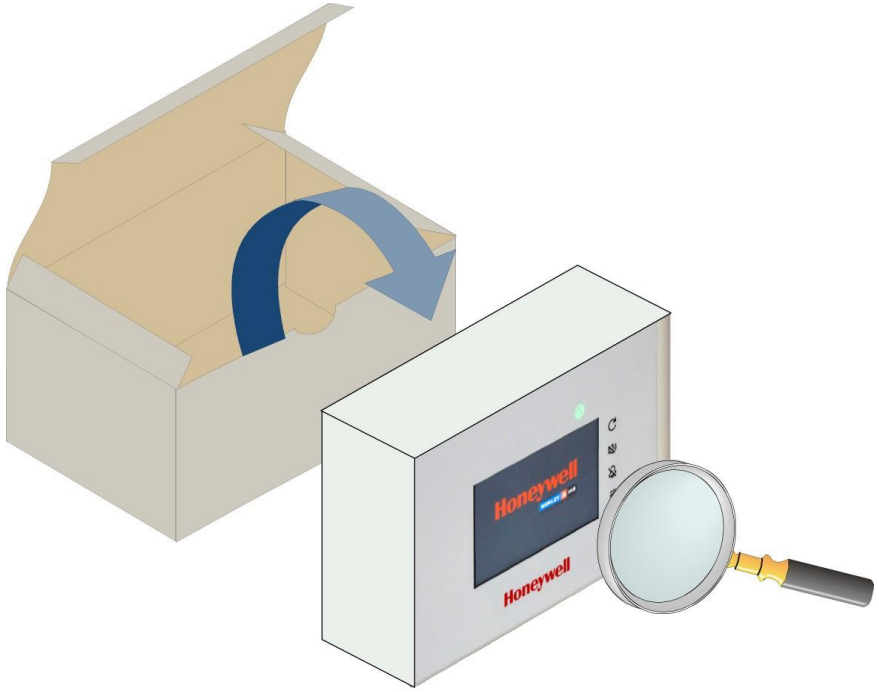

Fig. 1: Checking for damage (example with LT-32)

It is important to check all supplied equipment for damage before proceeding with the installation! Before attempting to install the LT-32 / LT-159 control panel, or other equipment, you must do the following:

1. After removing the FACP, modules and other related equipment from its packaging, and before you proceed with installing it in its chosen location, check for any damage that may have occurred while in transit.

   In the unlikely event that any of the supplied FACP items has been damaged, you MUST NOT install it but return it to your supplier, see the following section.

2. If you are satisfied that none of the supplied items has been damaged, you can now proceed with installation. Refer to the relevant sections that apply to your installation/configuration requirements.

Danger – Electrical shock!
Remove all power from the FACP before carrying out any installation work!

ESD protection
While handling electronic assemblies, the necessary precautions against electrostatic discharge must be taken.

WHAT TO DO IF THE EQUIPMENT RECEIVED IS DAMAGED

If you have problems regarding the quality of any supplied order items including the FACP, its ancillaries or items are missing, follow the procedure below.

1. DO NOT continue with the installation but, contact your supplier for advice on what to do next. Similarly, if the product is found to be faulty during installation contact your supplier immediately.
2. To aid your supplier and the manufacturer, you are requested to quote the manufacturer's unique batch reference number, which can be found on the packaging or inside the back box.
3. Note all the details relevant to your complaint, date of receipt, packaging condition and forward it to your supplier.
4. Were the product needs to be returned to your supplier, you are requested to use the original packaging, or suitable anti-static equivalent, wherever possible.

2.1 Pre-installation Check List

Before installing the LT-32 / LT-159 FACP you must first ensure that the following criteria have been met. Failure to do this, may not only result in damage to the equipment but may also cause problems during commissioning operations, or adversely affect its performance:

- DO ensure the operating ambient temperature where the panel is installed is in the range: -5°C ... +40°C.
- DO Ensure the panel is installed where the relative humidity is between 5% ... 95% non-condensing.
- DO Ensure the panel is installed in an area where solids and liquid entering is not beyond IP 30 rating.
- DO NOT site the panel where there would be restricted access to the inside of the equipment and to the internal cabling and wiring connections points.
- DO NOT locate the panel where there are high levels of vibration or shock.

TRANSIENT PROTECTION

This equipment contains transient-protection devices. Although no system is completely immune from lightning transients and interference, to allow its correct functionality and to reduce susceptibility, this equipment must be earthed correctly.
As with all static sensitive electronic components, this system may operate erratically or can be damaged if subjected to lightning-induced transients.
The use of overhead or outside aerial wiring is not recommended, due to the increased susceptibility to nearby lightning strikes.

3. INSTALLATION OVERVIEW

The panel range is designed for mounting onto an internal wall of a protected building and is not suitable for mounting on outdoor applications.

1. Install the panel enclosure in accordance with the instructions reported in this manual.
2. Bring the field wiring/cables through the recommended entry points on the backbox. Prepare all cable/wiring entry with appropriate fire industry-approved cable glands and label all field wiring correctly to aid termination.
3. Install a fire industry-approved, AC mains power supply isolator 'fused spur unit' close to the FACP. The mains supply cable must be brought into the enclosure, using a recommended cable entry point.
4. Use this manual for recommendations on how to install batteries inside the enclosure.
5. Once individual cables are checked, make the wiring of each circuit. The battery link is fitted during the commissioning power up stage.

4. SPECIFICATIONS

- 4,3" / 109,2 cm Touch-screen graphical color display, 480 x 272 pixel with back illumination and backlit membrane buttons
- LT-32 manage up to 32 wireless or addressable devices.
- LT-159 manage up to 159 addressable devices, mainly wireless.
- 16 Zones
- Fire and Fault relay NO/NC configurable using related jumpers.
- One sounder circuit in the LT-32 / LT-159 (max. load 50 mA each)
- Output delays max. 10 minutes (according to EN 54)
- 8 illuminated status icons: Fire, System Fault, General Fault, Disable, Test, Sounder Fault, Power Fault, Power
- 4 operating buttons: Reset Panel, Silence Buzzer, Silence Sounders, Evacuate
- The internal panel buzzer provides an audible alert to the authorized user, to take immediate action whenever the system detects any condition such as a fire or fault event. Depending on the type of event, the buzzer activates (sounds) using a different tone pattern. The SILENCE BUZZER control button is used to silence (mute) the internal buzzer after it has switched on following an event. This control is available at all access levels, without a need for PIN code.
- AC power supply with different plug options with a maximum rate power of 24 W
- Autonomy in standby and alarm time, in absence of main power, are based on the system configuration. Please refer to Honeywell Loop Calculator for more details
- Panel Is specified for small applications, especially for wireless devices. Max. loop distance: 500 m, cable resistance below 10 Ohm (depending on the loop load current)
- 6 AA-size 2,700 mAh Nickel metal hydride (Ni-MH) battery
- Panel configuration and event log retrieval can be done through a USB Type B port using the desktop application.
- Two serial ports are available for connecting to external systems to enable remote operations.
- Imin= 200 mA
- Imaxa= 500 mA
- Imaxb=1,5 A
- Maximum RiMin = 0,7 Ohm
- Certified EN 54-2 / AC / A1
- Certified EN 54-4 / A1 / A2
- Certified LVD 62.368-1:2014+A11

4.1 Mechanical Specifications

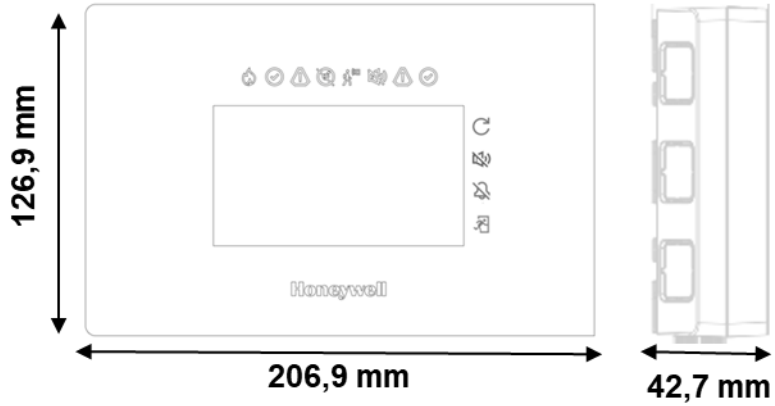

Fig. 2: Dimensions

- Dimensions in mm: 206,9 x 126,9 x 42,7 (width x height x depth)
- Upper and lower cable entry for 15 mm cable gland
- Side entries: 3 on each side (23 x 21 mm easy access)
- Central entry prepared for 60 mm universal flush box.
- External connections: Removable Terminals for cables 0,5 mm^2
- Housing color: LT-32 -> RAL 9002 / LT-159 -> RAL 9005
- Material: ABS flame retardant UL94 class V-0
- Weight: 400 g (incl. 6 batteries)

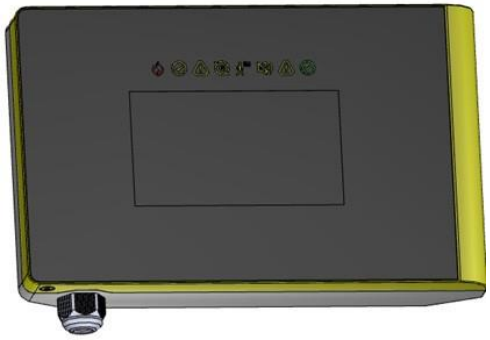

Fig. 3: Front View

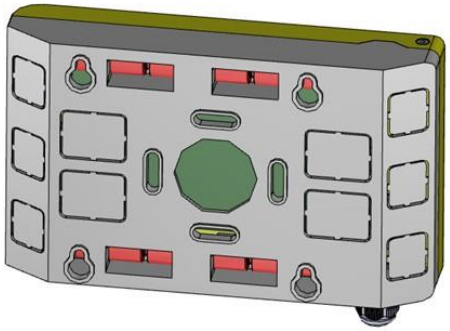

Fig. 4: Back View

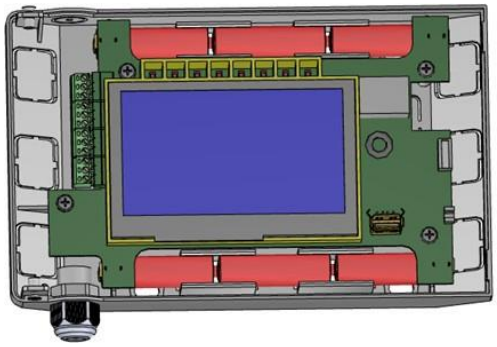

Fig. 5: Internal View

4.2 Electrical Specifications

- External power supply: 100 ... 240 Vac, 50 ... 60 Hz
- Power connection terminal: European standard AC. UK connector (Type G adapter) option available
- Maximum power consumption: 24 W
- 1 Supervised sounder output with max. 50 mA
- Max. 500 m distance depending on the cable section and current consumption in alarm.
- 1 Alarm relay with configurable NC/NO contact
- 1 Fault relay with configurable NC/NO contact

4.3 Environmental Specifications

- Climate classification: K5 (IEC 721-2-3)
- Temperature range: -5ºC ... 40ºC
- Relative humidity: 5% ... 95% non-condensing
- Control panel protection rating: IP 30 (acc. EN 60529)

5. PANEL PARTS – FRONT VIEW

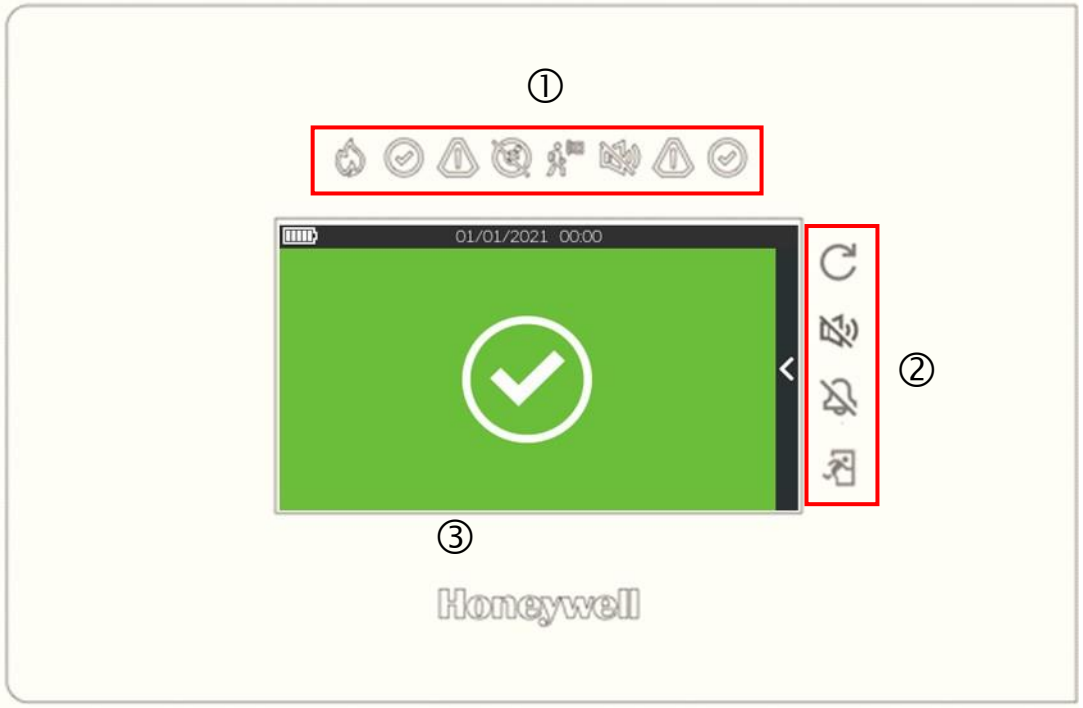

Fig. 6: Front view

①	LED Indicators
②	Functional Buttons
③	Touch Display

5.1 Panel parts – Internal View

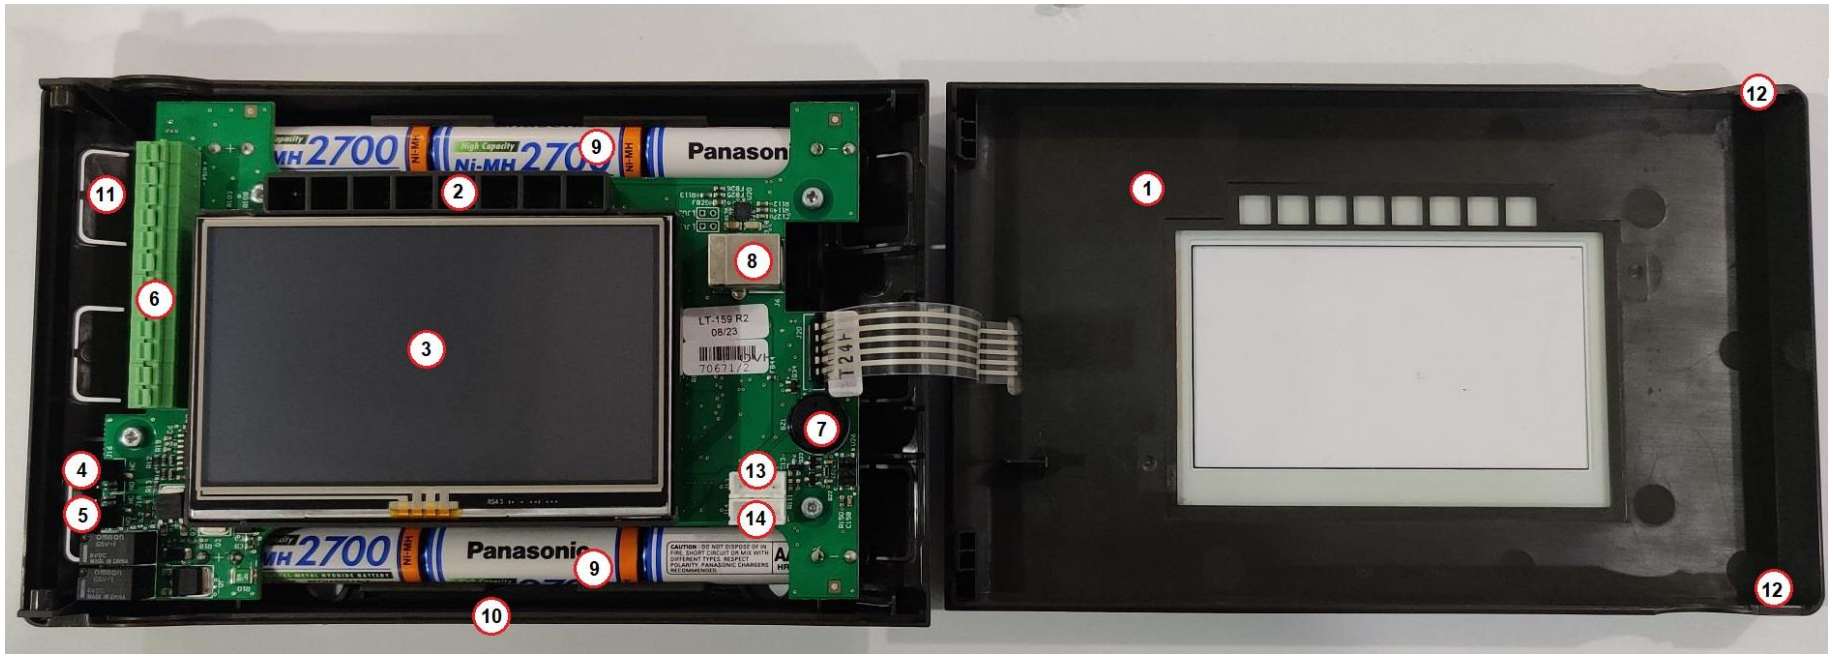

Fig. 7: Internal view

1	Front Cover	8	USB Port B Type
2	LED Indicators	9	Batteries Location
3	Display	10	Rear Cover
4	Fault Contact Jumper	11	Cable Entry Holes
5	Alarm Contact Jumper	12	Panel Closing Screws
6	Terminals	13	Serial Port 1
7	Buzzer	14	Serial Port 2

Fig. 8: Power Supply and Batteries

Batteries used within this product may only be replaced by batteries that are in compliance with IEC 60896-11, IEC 60896-21, IEC 60896-22, IEC 61056-1 and IEC 61056-2 or IEC 62485-2 and made of material with flammability rating V-1 or better.

6. PANEL INSTALLATION

The equipment must be installed indoors, with requirements refer chapter 4.3.
The installation of the panel must be carried out by qualified personnel. The electronic components that make up of the equipment, are vulnerable to physical damage or electrostatic discharge. It is advisable to take anti-static precautions.
The equipment must be installed on a flat, dry surface at eye level and so that the housing is not deformed.

Use the fastening elements provided or similar ones, adapting them to the type of surface.
The cables must be inserted inside the box through suitable means (cable glands, not provided), avoiding rubbing with the metal edges of the box. Use the pre-cut opening provided.

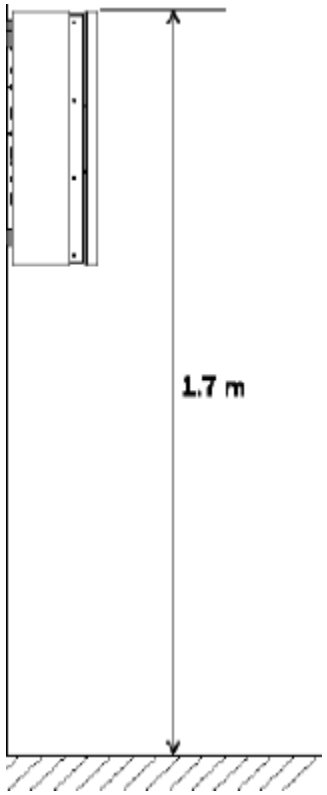

The panel must be mounted on a wall at a height of 1,70 m above floor level, such that the display is just above normal eye level.

Fig. 9: Mounting hight

6.1 Surface Mounting

The LT-32 / LT-159 FACP can be surface mounted onto a flat wall, using suitable fixtures and fittings (height between 80 ... 170 cm). As a general recommendation for type of wall surfaces, ensure assessments are made and suitable fixtures and fittings are used to hold the panel assembly. The panel backbox is mounted on a concrete block wall.

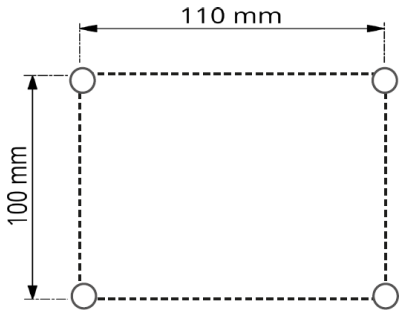

Fig. 10: Mark the required hole

STEP 1
According to the figure, mark the required hole on the wall.

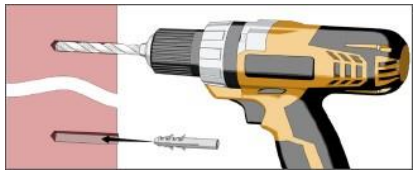

Fig. 11: Drill holes

STEP 2
All fixing point must be used.
Use 50 mm long x 5 mm diameter screws to secure the backbox on the wall.

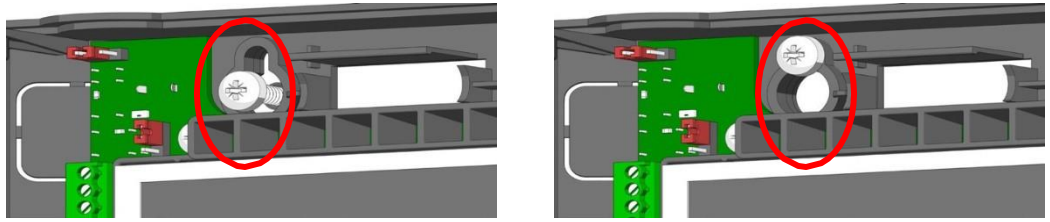

Fig. 12: Mounting backbox

STEP 3
Align the screws on the cover with the keyhole on the back box and lock the cover onto the backbox.

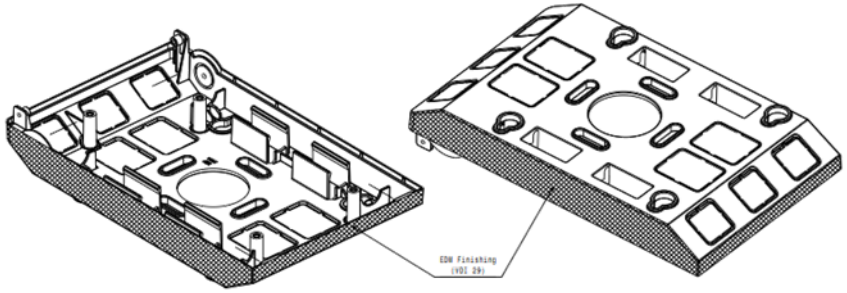

Fig. 13: Cable Entries

CABLE ENTRIES

- Upper and lower cable entry for 15 mm gland
- Side entry: 3 on each side (21 x 21 mm easy access)
- Central entry prepared for 60 mm universal flush box

7. CABLING

All wiring must comply with local regulations. Also observe the requirements for cabling and interconnection of a fire detection and alarm system. For information on how to wire compatible field devices, please refer to the related product documentation.

CABLING INSTRUCTIONS

1. Cables must be brought into the enclosure using the 20 mm cable entry points provided on the top and rear of the panel enclosure. Ensure that all openings in the enclosure are closed before connecting power to the panel, to prevent inadvertent access to hazardous voltages.
2. Tails must be of sufficient length to connect to the respective terminal at the commissioning stage.
3. Cables that are screened must be terminated at the panel enclosure and earthed at points provided on the top side.
4. The mains supply must be suitably fused and rated as per specifications. Mains supply must have a dedicated path from the site distribution board, with an over-current protection device rated at a maximum of 16 A.
5. The cable entry points on the extreme right-hand side must be used for mains cable entry. DO NOT route mains cable using any other cable entry points and ensure that the mains wiring is always separated from the low voltage wiring. It is good practice to always isolate the mains power at the external isolator equipment, to make the panel safe when performing maintenance tasks, involving the panel's electronic equipment.
6. All low voltage cables must have a minimum 300 V AC rating.

CABLE GLANDS

Fire-industry-approved, M20 cable glands must be used, made from metal or having flammability class V-1 rating or better.

CABLE TERMINATIONS

This section provides guidance on where to bring cables into the Control Panel enclosure for ease of termination. Ensure the following requirements are met:

1. The mains supply must be brought into the FACP such that the cable path to the mains terminals block is kept as short as possible.
2. All loop and ancillary cable terminations must be brought into the panel enclosure using cable entry points close to their final connection points to respective terminals, to ensure tails are kept as short as possible. To facilitate this most, modules can be fitted to the required slot location on the module carrier.
3. Some cable entry points must be left unused to provide adequate mains supply input/signal cable segregation.

QUALITY OF CABLE

It is vitally important that good quality cable is used and that correct installation techniques are followed. In general, the following cable installation requirements must be met:

1. All cable sections must be circular to allow effective cable clamping using the cable glands.
2. The cable must be screened (sheathed) to provide protection against Radio Frequency Interference (RFI) and the screen must be connected to earth at the control panel (earthing points are provided on the inside enclosure top side).
3. The cable screen must be continuous throughout the loop. Please connect the screen to a ground/earth point.

LOOP CABLE LENGTH

A loop circuit consists of devices such as detectors and modules. The length of a loop circuit cable used can be significantly affected by the loading of the device on a loop circuit. The length can be up to 500 m and is determined by cable type and loop loading.

RECOMMENDED CABLES

Type of cable: 2 conductors (for their section refer to the table below)

- Twisted narrow pitch (5 / 10 cm)
- Shielded pair cable
- Max. admitted capacity: 0,5 µF
- Max. resistance depending on the current loop in alarm (number of sounder / strobes activated simultaneously): 10 Ohm.

CABLE SECTIONS

The proposed sections are referred to the total length of the line (in case of Class A loop and therefore when the loop is closed, it is considered the loop length) which, however, must not be longer than 500 m and the total resistance of the line must be lower than 10 Ohm.

MINIMUM CABLE SECTIONS	
Up to 100 m	2 x 0,5 mm^2
Up to 250 m	2 x 1,0 mm^2
Up to 500 m	2 x 1,5 mm^2

7.1 Cable Routing and Connections

Remove the keyholes ① and pass the cables ② through them.

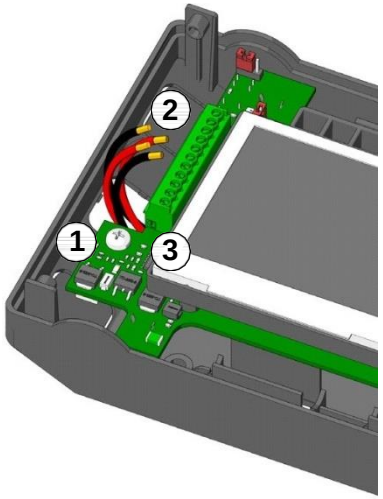

Fig. 14: Cable routing and connections

③ LT-32 / LT-159	Ref.	Description
	1	Power +
	2	Power -
	3	Fault NO/NC
	4	Fault C
	5	Loop A +
	6	Loop A -
	7	Loop B +
	8	Loop B -
	9	Sounder 1 +
	10	Sounder 1 -
	11	Alarm NO/NC
	12	Alarm C

Sounder circuit
End of line diode cathode marker on positive terminal.

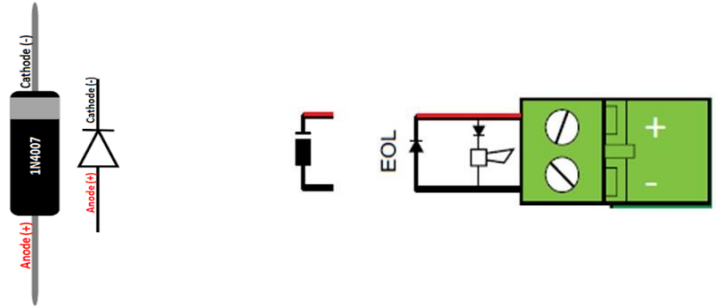

Fig. 15: Example of sounder circuit

FAULT/ALARM RELAY CONFIGURATION
The fault/alarm relay can be configured as normally open or normally closed, using the Jumper J16 for the Fault Relay and J18 for the Alarm relay.

LOOP CONNECTION
LT-32 / LT-159 requires a closed loop: connectors - A + and – B + are used to connect side “A” and side “B” of the loop.

SOUNDER CONNECTION
LT-32 / LT-159 is equipped with one sounder output: OUT 1 balanced with a diode provided with the panel.

POWER CONNECTION
LT-32 / LT-159 have a PSIN connector to wire the provided AC power supply.

SERIAL PORT CONNECTION

The panel is equipped with two serial ports J13 and J14 for connection to external systems using Third Party (TPP) and Plus Vision protocols. Pin connections for each serial port are as shown.

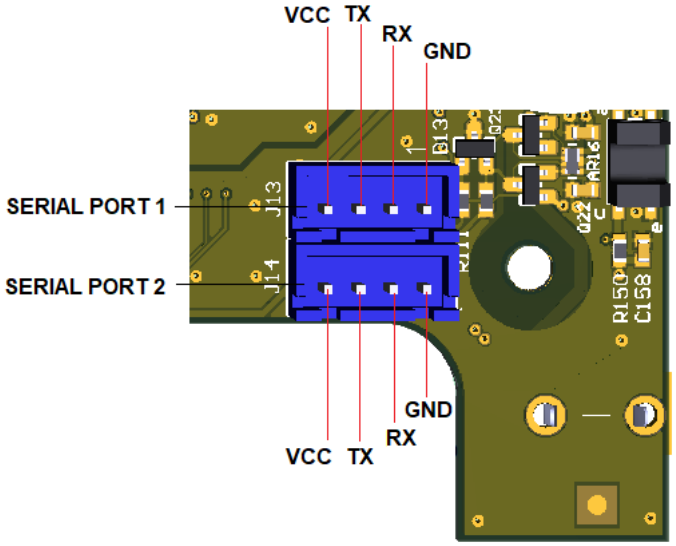

Fig. 16: Serial ports and their pinout

For all the connections, please refer to the below figure.

7.2 LT-32 / LT-159 Setup and Connections Overview

Fig. 17: LT-32/LT-159 setup and connections overview

①	Relay Setup 	
②	5	Loop A +
	6	Loop A -
	7	Loop B +
	8	Loop B -
③	Batteries connected in two rows with polarity as shown.	

When the front cover is opened a tamper fault is reported. Fault is reset automatically once the cover is closed again.

8. DETECTORS AND MODULES OVERVIEW

A Detector device such as a Smoke or Heat detector:

- Has a given a unique "Address".
- Can be given a location label of up to 20 characters.
- It is associated to a "Zone".
- Has a working LED indicator on each device.
- Has a Remote LED option
- It is operating at its sensor sensitivity profiles.

A Module device such as an Input/Output Interface, Sounder-Strobe, Manual Call Point on a loop:

- Has a given a unique "Address".
- Can be given a location label of up to 20 characters.
- It is associated to a "Zone".
- Has a working LED indicator on each device.

Due to the limited battery capacity, the maximum number of wired loop-powered addressable devices is limited, depending on the type of devices, the number of 159 is reached with wireless devices.

Please use the "Battery Calculator" tool to determine the limits of wired devices in your installation.

9. DISPLAY AND CONTROLS

The touch screen display and LED indications, allow the user to review the system status and, with appropriate user PIN, have access and perform tasks in accordance with the requirements of the local fire regulations. There are 8 status icons provided on the front panel and 4 push buttons for event conditions.

STATUS ICON	CONDITION / CONTROL	COLOR	DESCRIPTION
	FIRE	Red (blinking)	A fire condition has been detected (buzzer active)
		Red (fixed)	The user has acknowledged the event by buzzer silence
	SYSTEM FAULT	Yellow (fixed)	System fault
	GENERAL FAULT	Yellow (blinking)	General fault, buzzer is active
		Yellow (fixed)	The user has acknowledged the event by buzzer silence
	DISABLE	Yellow (blinking)	A device or zone is disabled
	TEST	Yellow (blinking)	A zone is in test mode
	SOUNDER SILENCE	Yellow (blinking)	The internal buzzer is silenced
		Yellow (fixed)	The sounders are silenced
	POWER FAULT (from 100 ... 230 Vac or batteries)	Yellow (blinking)	Mains fault
		Yellow (fixed)	Batteries fault
	POWER	Green (fixed)	The system is switched on and the power is supplied via the mains

PUSH BUTTON	DESCRIPTION	FUNCTION
	RESET PANEL	Pressing the ‘Reset Panel’ button will reset the panel to return it to normal condition after an event
	MUTE	Pressing the ‘Mute’ button or tapping on the touch screen, will silence the active panel buzzer
	SILENCE SOUNDERS	Pressing the ‘Silence Sounders’ button will silence all Alarm sounders
	EVACUATE	Pressing the ‘Evacuate’ button and later confirm the evacuation in the pop-up window, will start all the panel sounders output activation and the output configured for evacuation in the Cause and Effect I/O Matrix

10. SYSTEM DEFAULT PASSCODE

PASSCODE ENTRY

When a function is protected by passcode, the below screens appear, indicating the Level required. Using the virtual keyboard, insert the passcode and confirm with enter:

Fig. 18: Screen ➔ Passcode Entry

FUNCTION	EN 54 LEVEL	FACTORY DEFAULT PASSCODE
Alarm, disabled, and faults display	Level 1	None
Alarm and faults recognition	Level 1	None
Disabled Zone/Point display	Level 1	None
Mute, Evacuate	Level 1	None
Reset Panel, Silence/Resound Sounders	Level 2	2222
Enable/Disable menu	Level 2	2222
Test menu	Level 2	2222
Utility menu	Level 2	2222
Programming menu	Level 3	33333333

If you do not remember the level 3 passcode, then press “Forgot Passcode”. The next screen will display a 20-character alpha-numeric recovery key. Contact Honeywell Technical Service and share the key, in order to recover the level 3 passcode. Insert the recovered level 3 passcode in the passcode entry and press the “enter” key to proceed.

11. DISPLAY OVERVIEW

The status of the unit and its connected devices is shown on the display. The display is turned off on stand-by and it can be reactivated just by pressing anywhere on the display screen.
The battery charge indication and the current date/time are always shown on the upper part of each page.

Fig. 19: Display when power up the unit

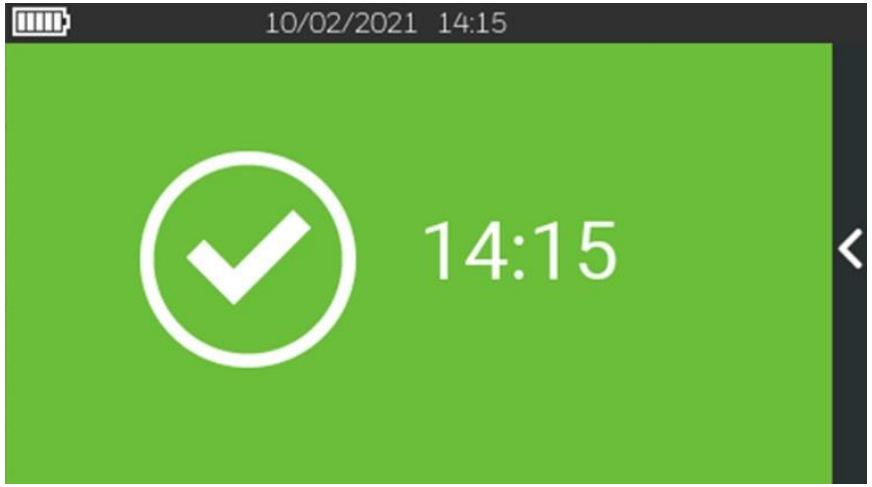

Fig. 20: Display in quiescent state

11.1 Display Indications and Buttons

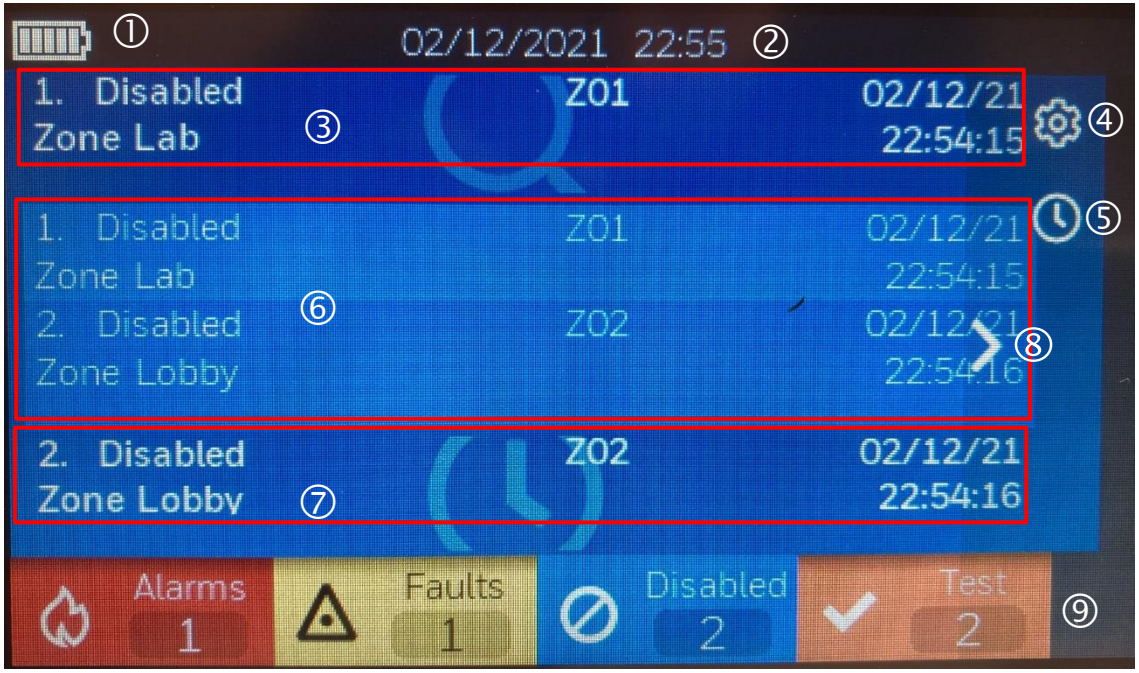

Fig. 21: Display indications and buttons

①	Battery Charge Indicator
②	Current Date & Time
③	Event Detail
④	Configuration
⑤	Delay Override
⑥	Event List
⑦	Last Event
⑧	Menu / Function Arrow
⑨	Event counters

The display change color based on the system condition, or the events visualized:

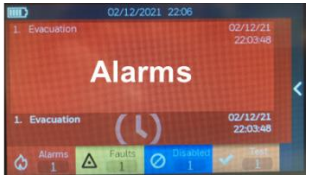

Red

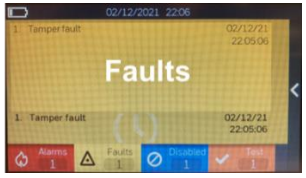

Yellow

Blue

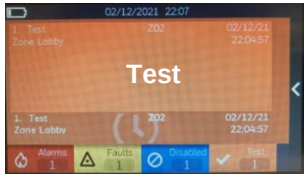

Orange

12. CONFIGURATION MENU

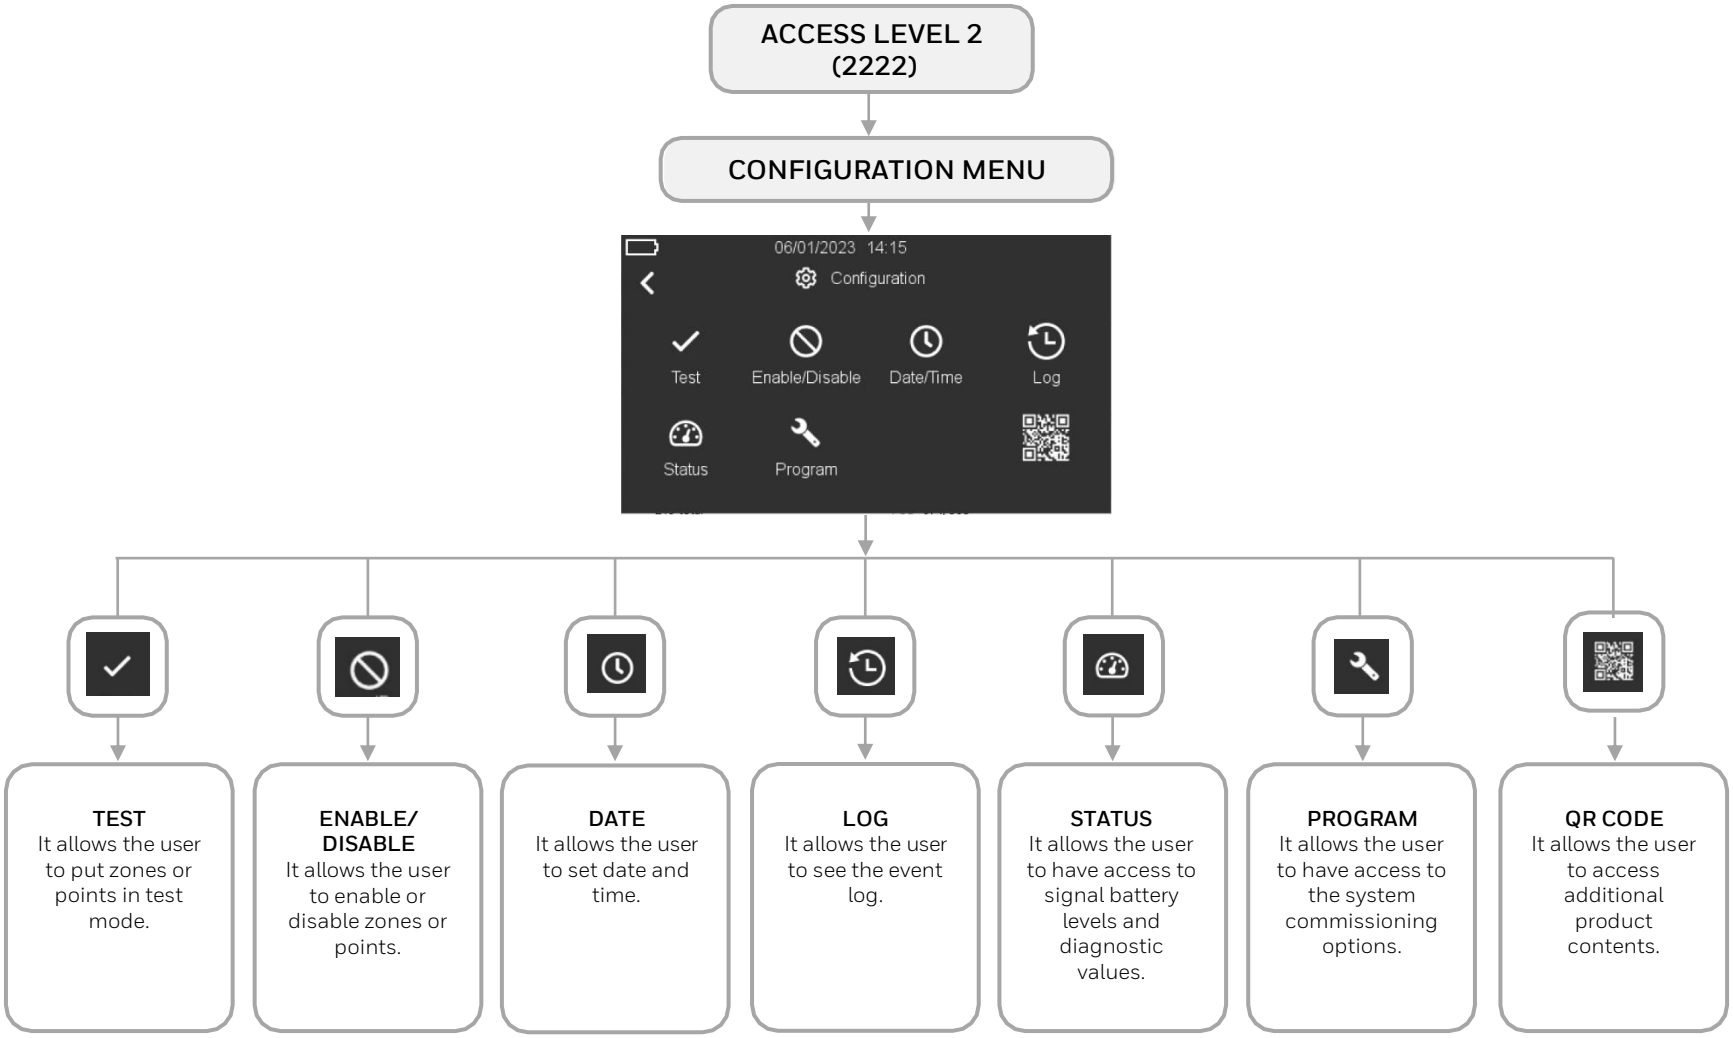

13. PROGRAM MENU

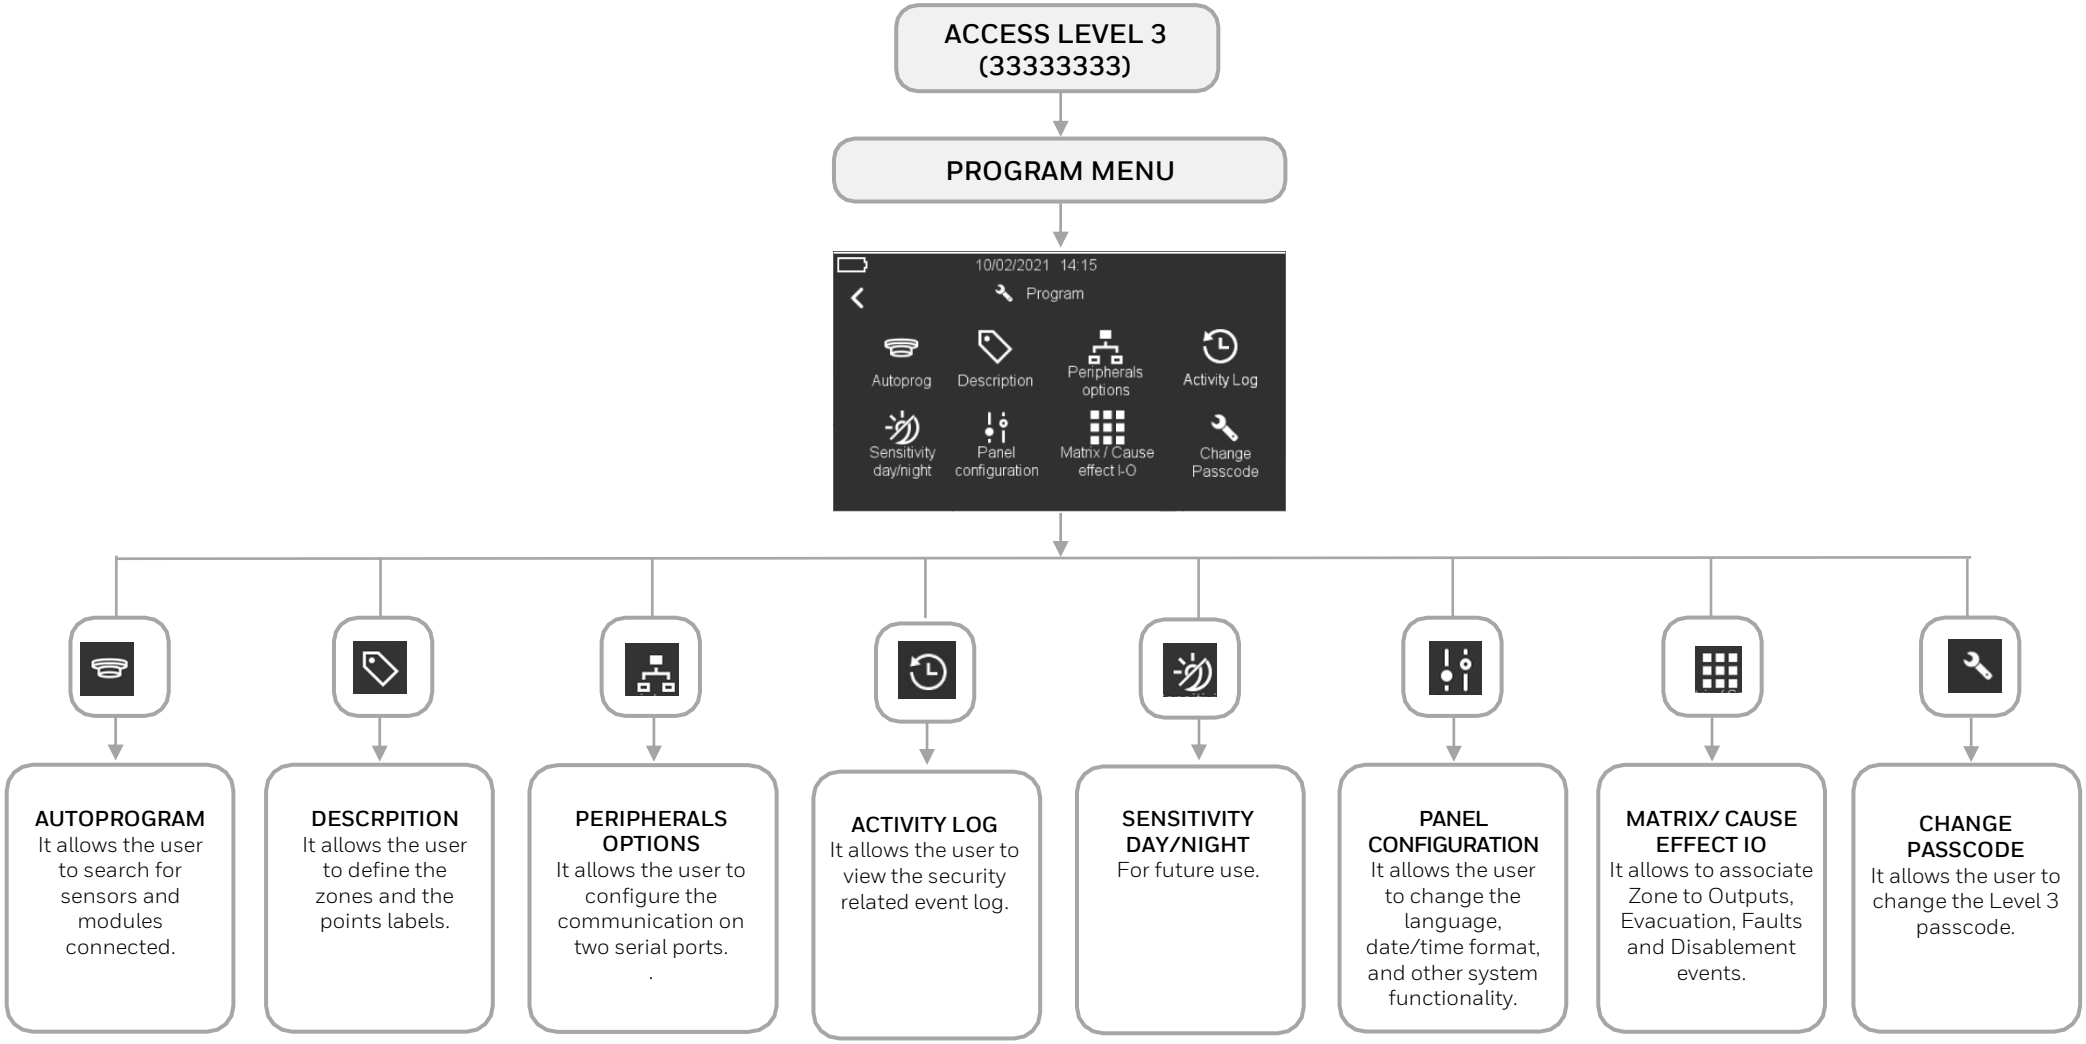

13.1 Configuration – Access to Menu

After having connected the devices and the power supply, activate it turning on the control unit and then connecting the batteries as shown in the previous setup and connection paragraph. When switched on, the programming of the panel must be carried out to allow detecting the connected devices.

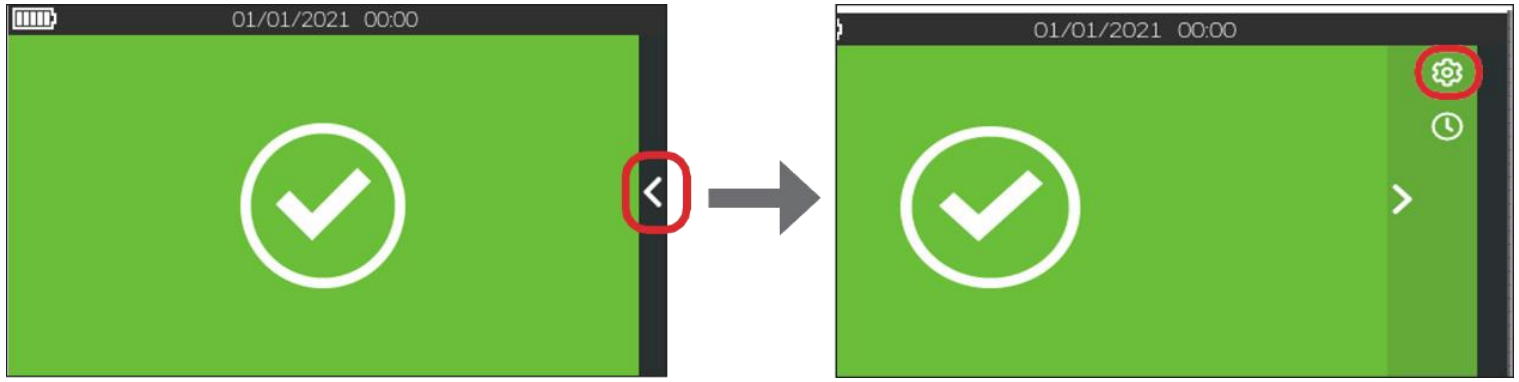

1. On the touch screen display press the arrow on the right and then press the gear icon at the top right:

2. The page above will be displayed. Insert the passcode of level 2 (2222) and press the "enter" key to confirm the passcode.

13.2 Configuration - Date and Time Setting

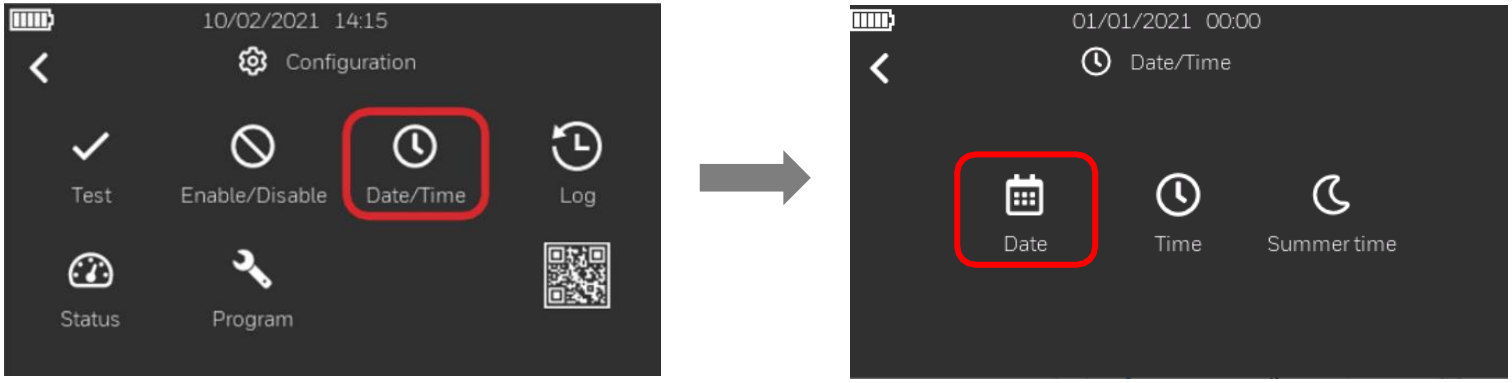

1. After having pressed the "Date/Time" icon in the “Configuration” menu, press the "Date” icon to set the current date.

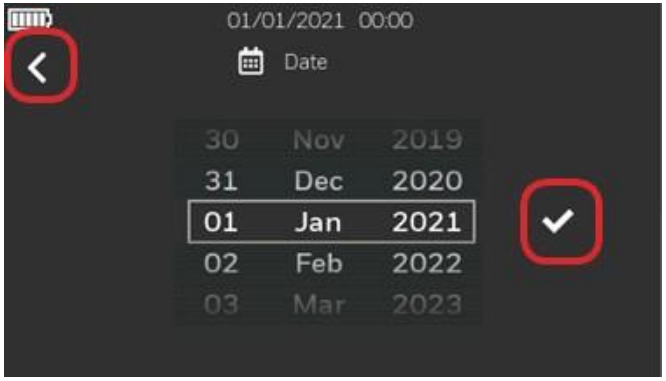

2. Insert the date and then press the check mark to save the setting. Press the back arrow to go back to the previous screen.

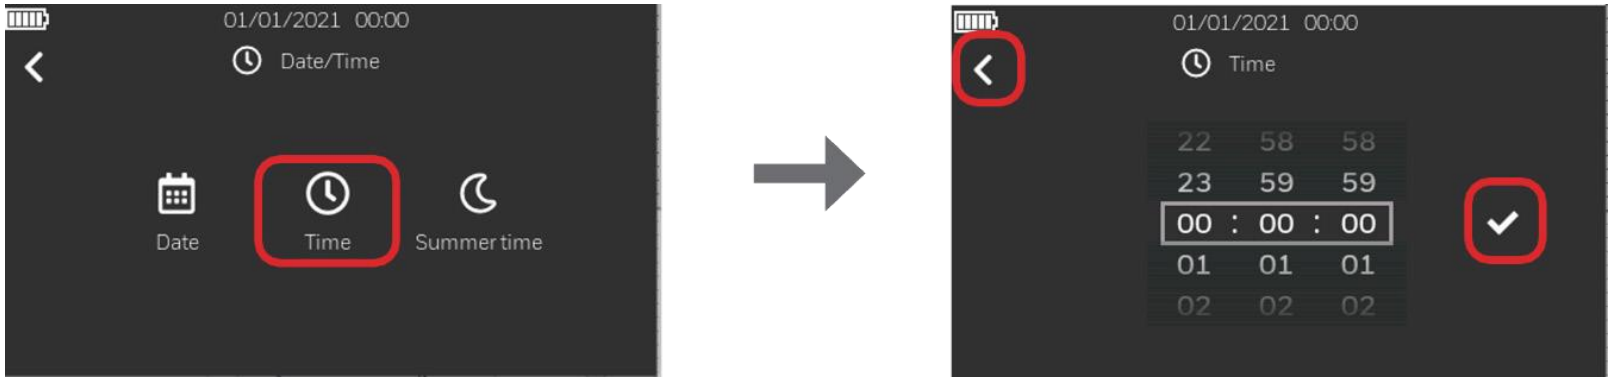

3. Then press "Time" icon to set the time and the check mark to save the setting. Press the back arrow to go back to the previous screen.

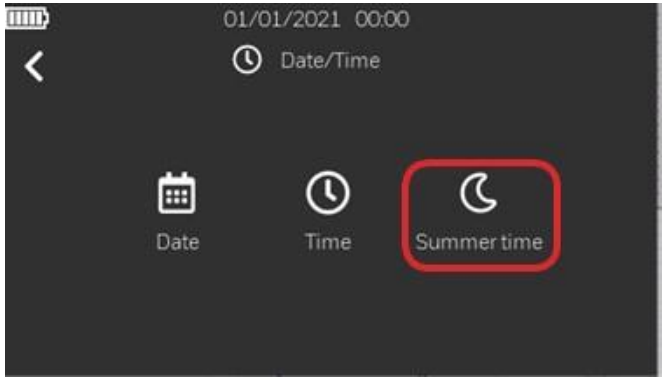

4. By pressing the following icon , you can set the “Summertime” **(future implementation)**.

13.3 Configuration – Panel Configuration

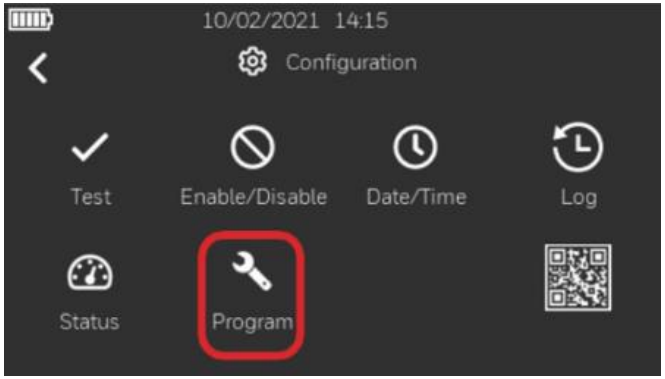

1. Press on the “Program” icon and insert the passcode for level 3. Press the "enter" key to confirm the passcode. Press on the back arrow to go back.

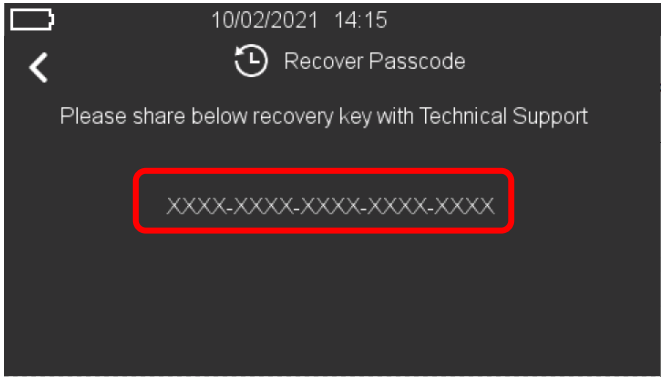

If you do not remember the level 3 passcode, then press “Forgot Passcode”. The next screen will display a 20-character alpha-numeric recovery key. Contact Honeywell Technical Service and share the key, in order to recover the level 3 passcode. Insert the recovered level 3 passcode in the passcode entry and press the “enter” key to proceed.

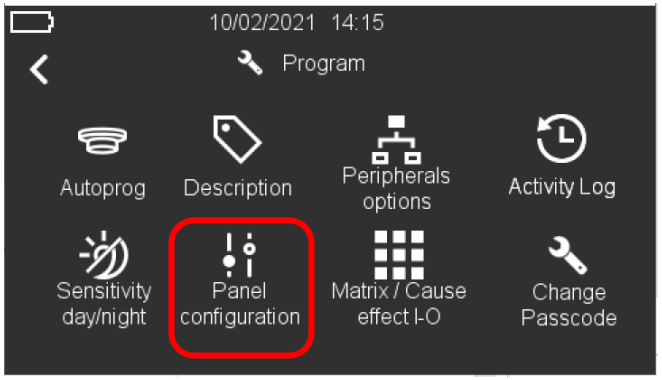

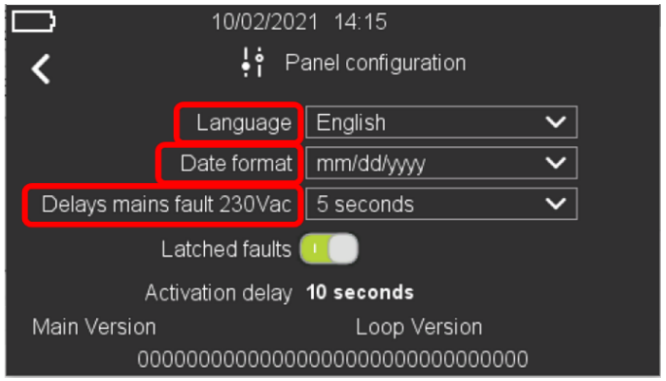

2. Press on "Panel Configuration" icon and insert the language of the system, the date and the time format and the delays mains fault value as shown in the screen on the top right. Data are selected and chosen by pressing on the down arrow.

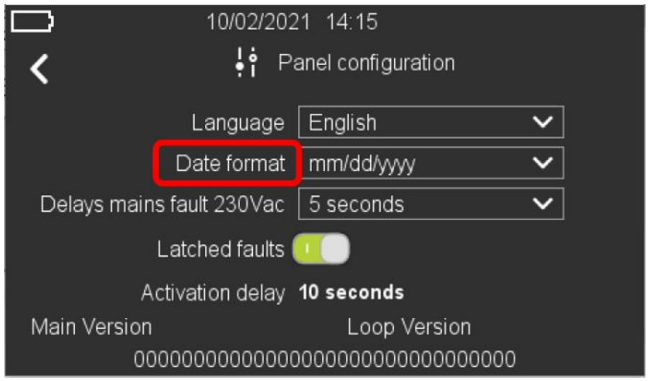

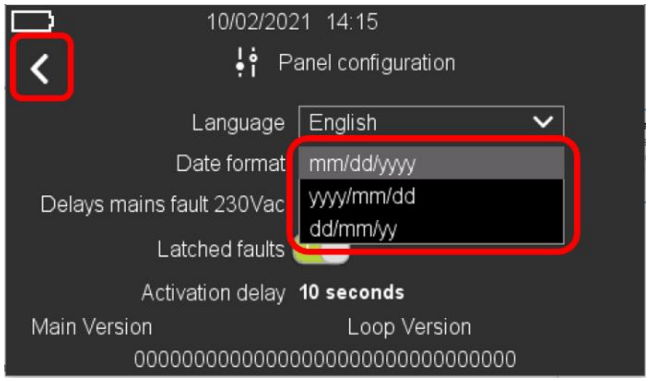

3. Pressing the arrow down on Date Format field, you can change the date format between mm/dd/yyyy, yyyy/mm/dd or dd/mm/yyyy. Press on the back arrow to go back.

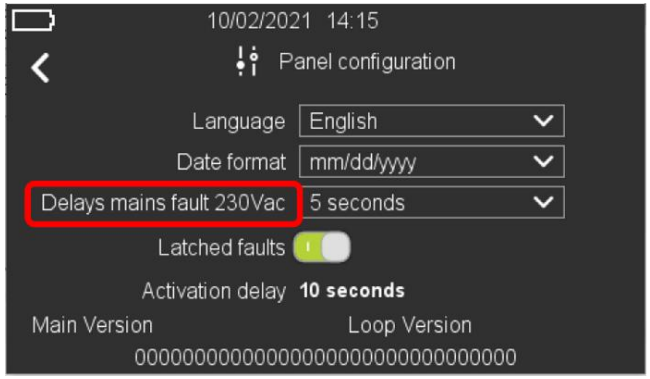

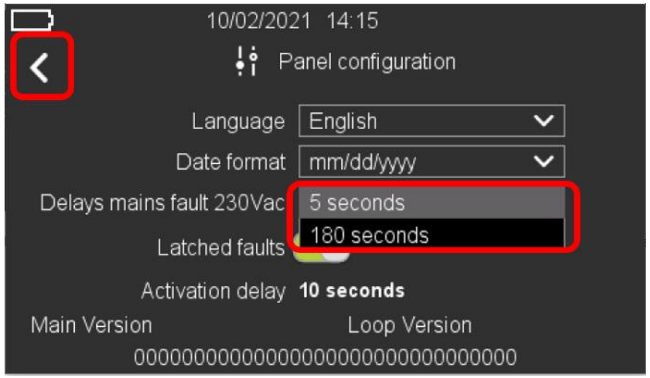

4. Pressing the arrow down on Delays mains fault 230 Vac field, you can change the mains fault delay time from 5 second (default) to 180 seconds. Press on the back arrow to go back.

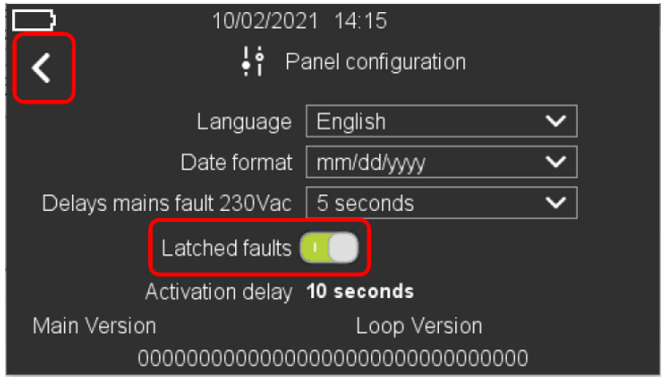

5. Latched Faults option, enable / disable all faults to work in latched mode or unlatched mode. When 'Latched Faults' is turned off, a fault condition is restored automatically after the event is cleared. Press on the back arrow to go back to the previous screen.

In unlatched mode, "@ unsupported" fault is not automatically reset. You must reset the panel to clear the fault.

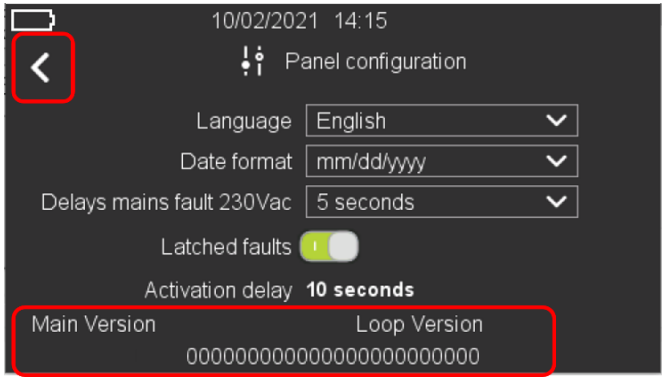

6. You also have visibility of the panel firmware version currently installed and a 24-digit unique serial number of the panel. Press the back arrow to go back to the previous screen.

13.4 Configuration – Peripherals Options

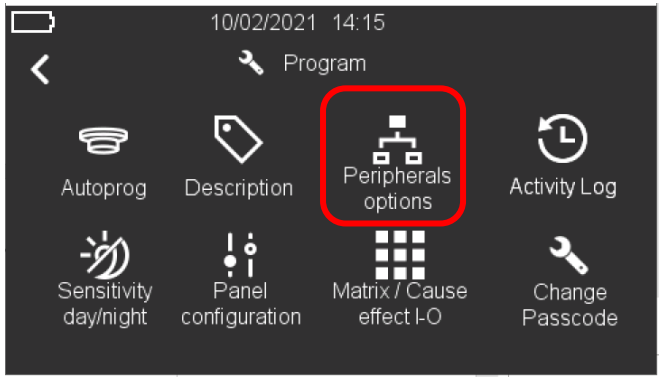

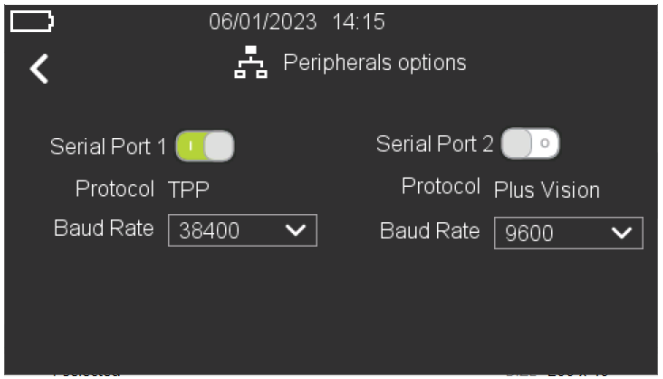

1. Select “Peripherals options” you can optionally configure the communication for the two serial ports with Third Party (TPP) and Plus Vision protocols respectively, along with the baud rate for each serial port.

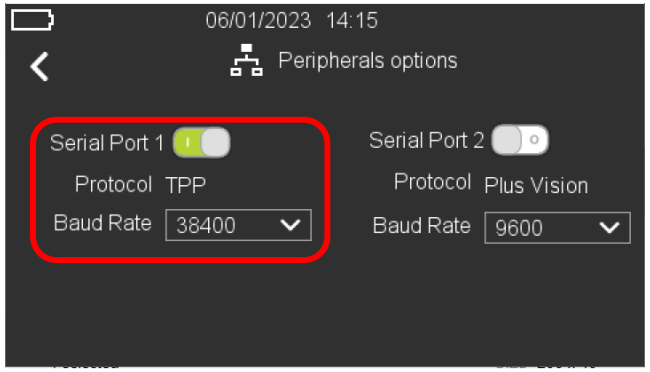

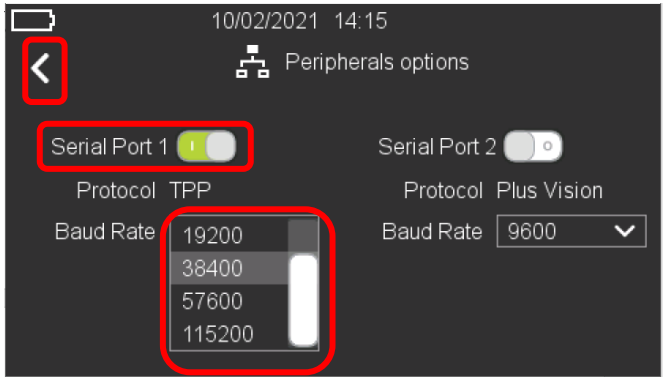

2. By default, Serial Port 1 is enabled for third-party (TPP) protocol communication at a baud rate of 38400.
   Pressing the arrow down on the Baud Rate field, you can change the baud rate from the list: 9600, 14400, 19200, 38400, 57600 and 115200.
   Click on the green circle near Serial Port 1 to disable the port when TPP communication is not used. Press the back arrow to go back to the main screen.

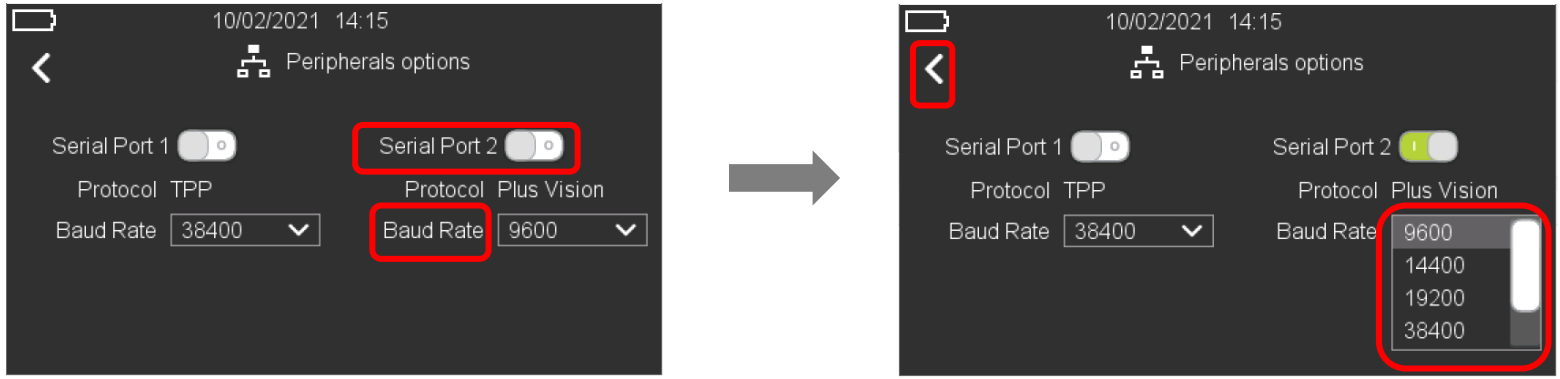

3. Click on the empty circle near Serial Port 2 to enable the port for Plus Vision protocol communication at a default baud rate of 9600. Pressing the arrow down on Baud Rate field, you can change the baud rate from the list: 9600, 14400, 19200, 38400, 57600 and 115200. Press the back arrow to go back to the main screen.

When the mains power supply fails and the panel operates using battery power, in the absence of any activity or active events, the display is turned off on stand-by and the panel goes to sleep.
In this mode, communication will be paused on the Serial Ports 1 and 2 for the Morley-IAS LT-32/LT-159 panels. Communication will resume once the panel wakes-up from sleep.

13.5 Configuration – Autoprog

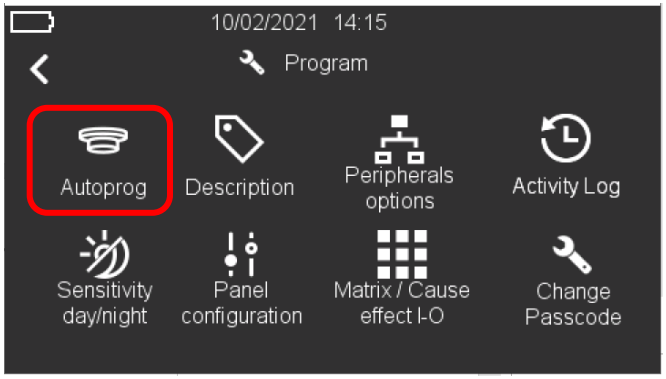

Select “Autoprog” then press on the magnifying lens to commence the searching of sensors and modules connected on the loop. After the scanning process press the check mark to save the configuration process. Press the back arrow to go back to the main screen.

The panel is not compatible with FAAST LT. The maximum number of WIRED loop powered devices is limited and must be defined using battery calculator tool. To reach 159 you need to use wireless devices.

Loop initialization
If loop initialization is in progress (e. g. at power on), Autoprog may be blocked. Therefore, the search icon may be greyed out and the message "Loop initialization" is shown to indicate that the user must wait until initialization is done. Once completed, the message disappears, and the search icon is enabled again.

13.6 Configuration – Description

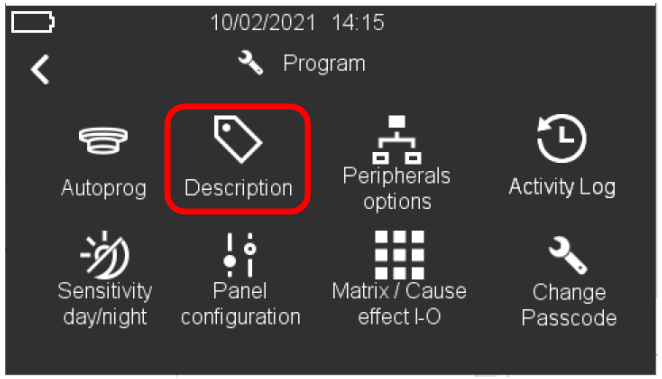

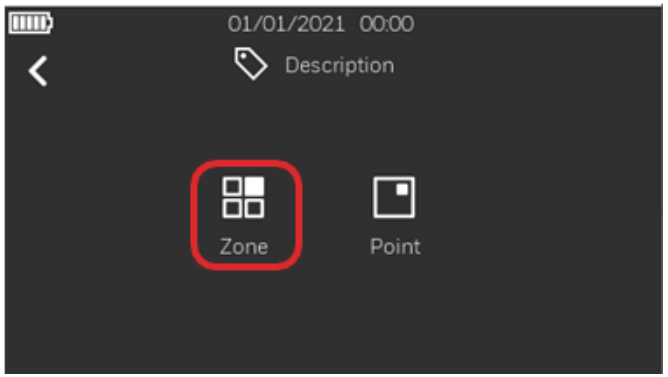

1. From the "Program menu", press the “Description" icon ; the "Zone" icon allows you to define the zones and the "Point" icon allows you to define the points.

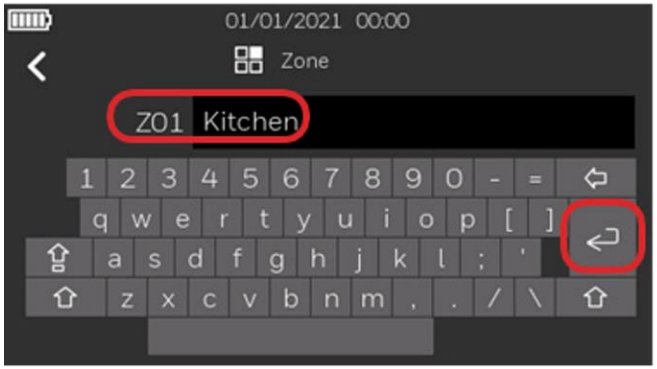

2. To define a Zone, press on the icon , then press at the right side of the zone number (e.g. Z01), below the icon and type the name of the zone. A QWERTY keyboard appears to enter the description. It is possible to insert up to 20 characters. Press the "enter" key to save and confirm the zone description. Press the back arrow to go back to the previous screen.

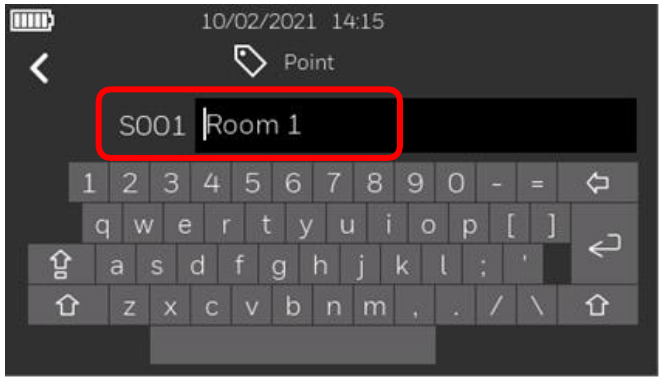

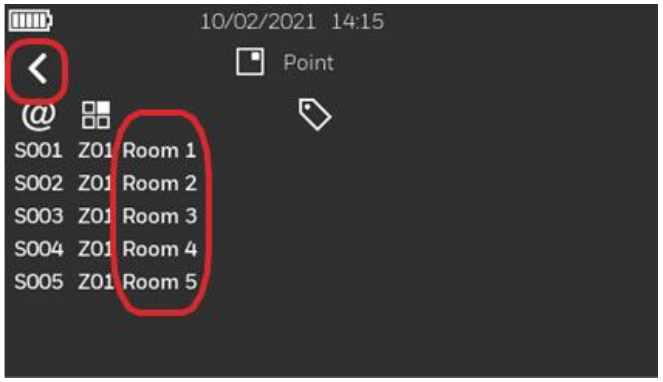

3. To define a Point, press on the icon , then press at the right side of the device number (e.g., S001) below the icon and type the name of the device. It is possible to insert up to 20 characters. Press the "enter" key to save and confirm the zone description. Press the back arrow to go back to the previous screen.

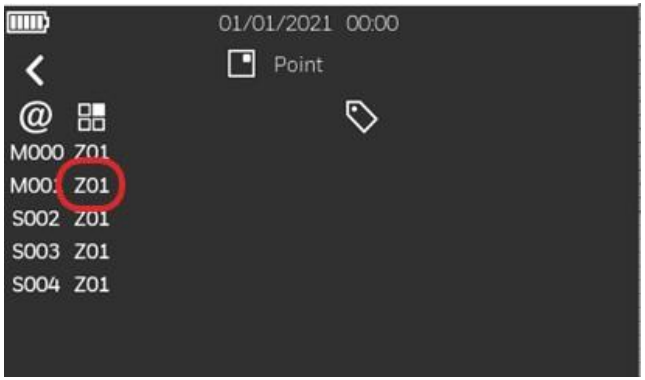

4. Press on the zone number to change the Zone to which the device is linked.

This icon indicates whether the device is a module (M) or a sensor (S).

This icon indicates the zone to which the sensor is linked.

13.7 Configuration – Matrix / Cause and Effect I/O

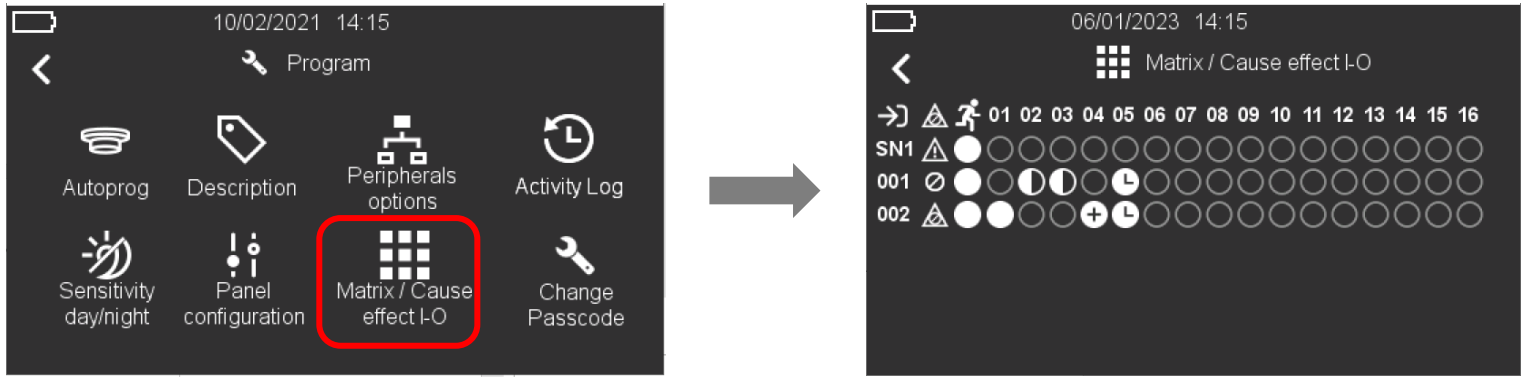

In this menu, you can associate the Zones, General Fault/Disablement events and Evacuation to the panel sounders and to the addressable outputs. The association happens simply clicking on the dot that cross the Zone/Function inputs and the outputs.

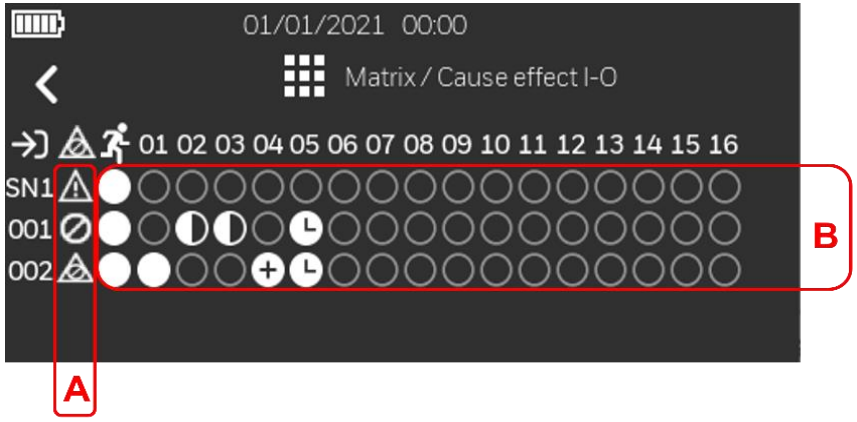

A) Icons relation to General Panel Fault and Disablements. Users can associate the panel fault & disablement conditions to the output devices.
B) Icons relation to Evacuation button & Zone activation. Users can associate Evacuation & Zone activations to each output devices.

A) Icons for General Fault & Disablement	
	Activates output with General Panel Fault. Any Zone, Device or Panel Fault will activate the associated output.
	Activates output with General Panel Disablement. Any Zone, Device or Panel Disablement will activate the associated output.
	Activates output with General Panel Fault or Disablement. Any Zone, Device or Panel Fault, or Disablement will activate the associated output

B) Icons for Zones and Evacuation button	
	Empty Dot - The Input and the output ARE NOT associated. No action will occur during an Alarm event.
	Full Dot - The Input and the output ARE associated. The output will activate immediately in the event of an Alarm.
	Half Dot - At least two Zones with the same selection Half Dot are required to be in Alarm to activate the relevant output. (Double consent/Knock Cross-Zone)
	Plus Dot - At least two devices related to the same Zone associated to the output must be in alarm to activate the relevant output (Double consent/Knock single Zone).
	Clock Dot - Indicates that the output will be activated once the countdown of the delay time configured into the Panel Configuration menu is finished. The Delay Override option is automatically enabled on the main screen menu, and you can override the delay time at any time pressing the button.

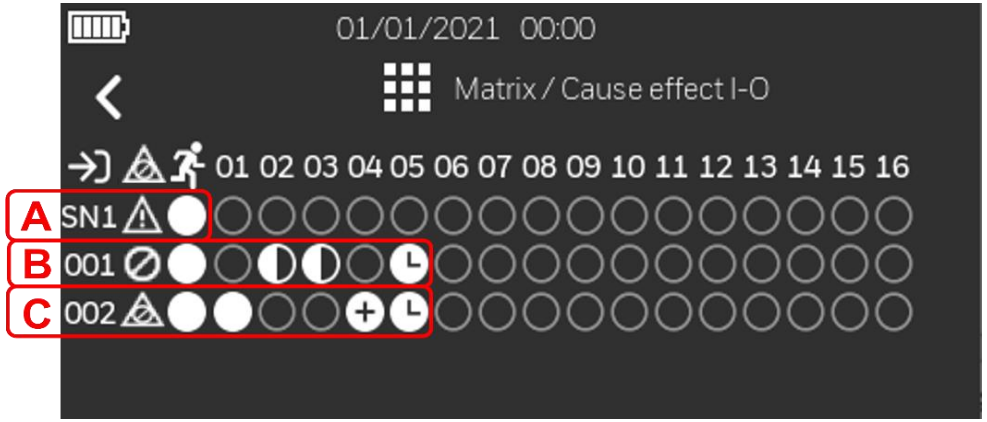

In the example shown, the I/O associations are:

A Sounder Circuit 1
- Activates with General Fault
- Activates with Evacuation Button Press

B Output Module 001
- Activates with General Disablement
- Activates with Evacuation Button Press
- Activates with coincidence (two devices in alarm) cross Zones 2 & 3
- Activates after delay with Zone 5 Alarm

C Output Module 002
- Activates with General Disablement or General Fault
- Activates with Evacuation Button Press
- Activates immediately with Zone 1 Alarm
- Activates with Point coincidence (two devices in alarm) from Zones 4
- Activates after delay with Zone 5 Alarm

13.8 Configuration – Activation Delay

1. Follow the steps to enter in "Panel Configuration" menu.
2. Click on the right of “Activation delay” option, then assigned the output delay activation from 0 (immediate activation) to 600 seconds and confirm with enter.

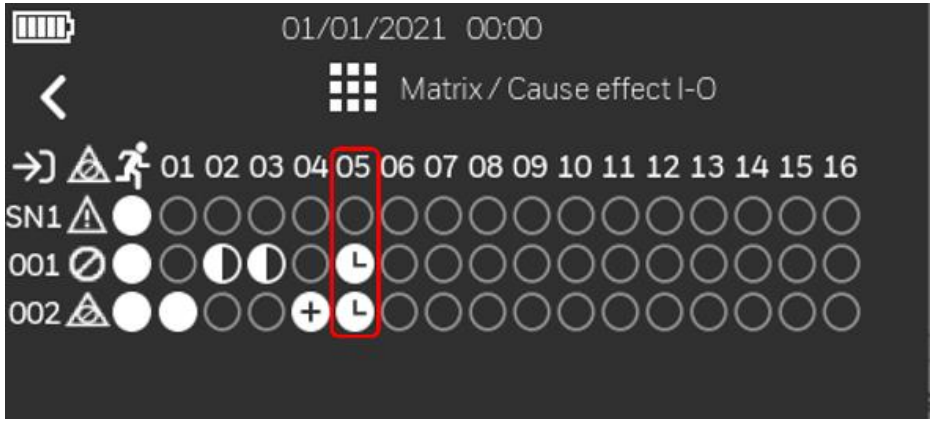

3. To enable the Output to be activated with the delay set, in the Cause and Effect I/O Matrix must be set the icon to the corresponded Output.

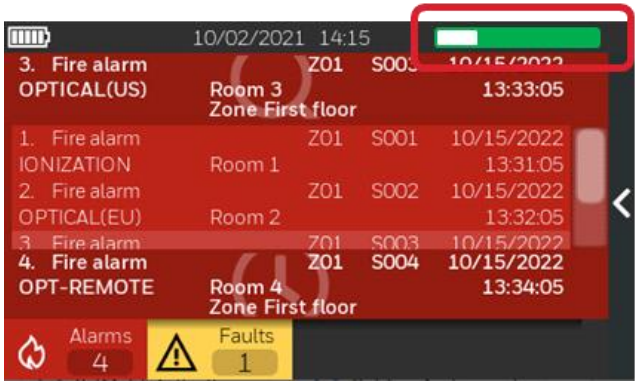

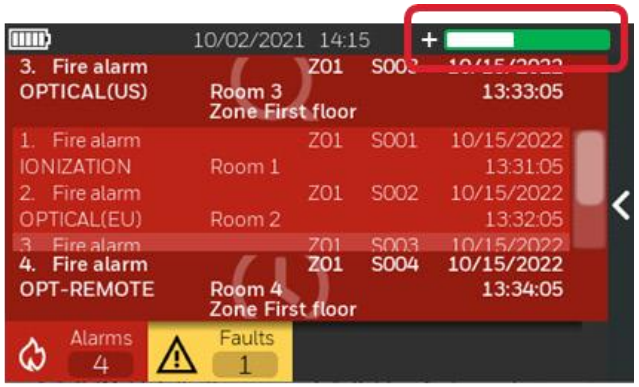

4. When a delay is active, a timeline appears on the main screen to show the delay progresses. If another Zone set to works with the delay goes into alarm, a + mark appears near the delay bar, indicating that another countdown is started.

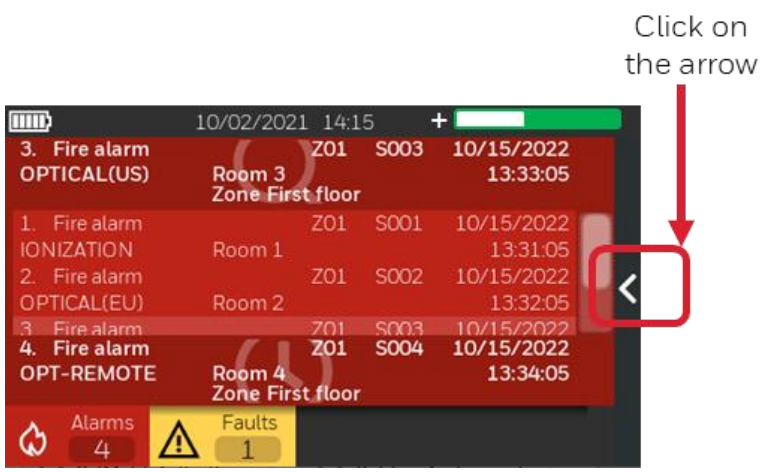

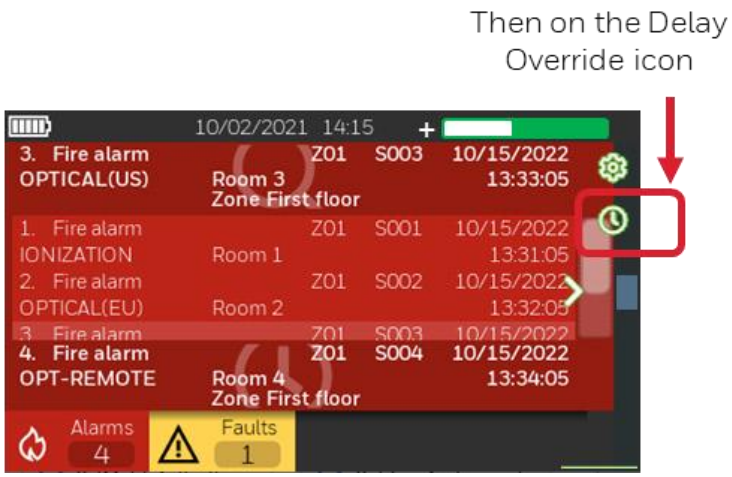

5. The Delay Override Option is now enabled on the main display, allowing the operator to activate the outputs configured for delay in the Cause and Effect I/O Matrix before the countdown is finished.

13.9 Configuration - Activity Log

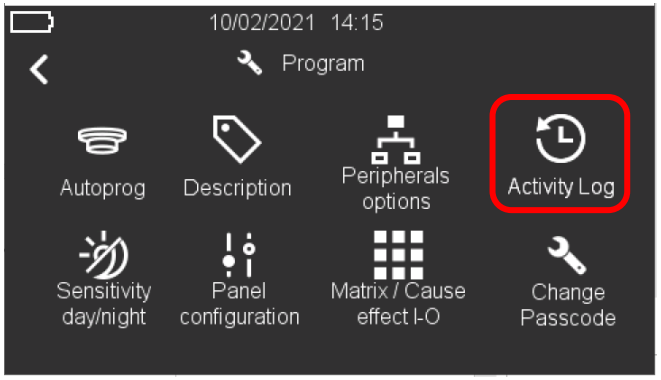

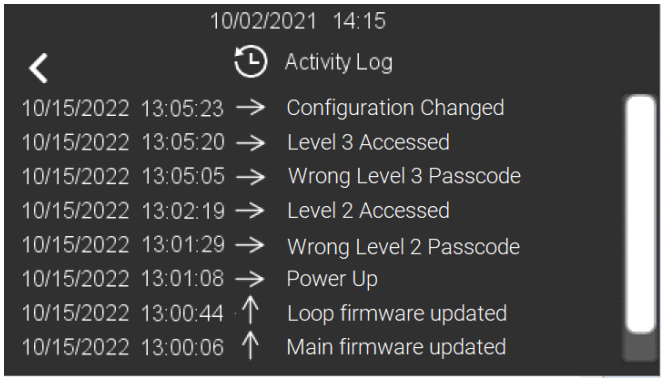

1. Select “Activity Log” to view event history.
2. The events are displayed in sequence, the latest is on top and the oldest appear at the bottom of the list. Events are displayed with the date and time, the type of the event and the event description. Also displayed are the commands released from the panel.

   The arrows indicate:
   - ↑ an event has started
   - ↓ an event is finished
   - → a command from the panel was released.
3. Press the back arrow to go back to the main screen.

13.10 Configuration – Change Passcode

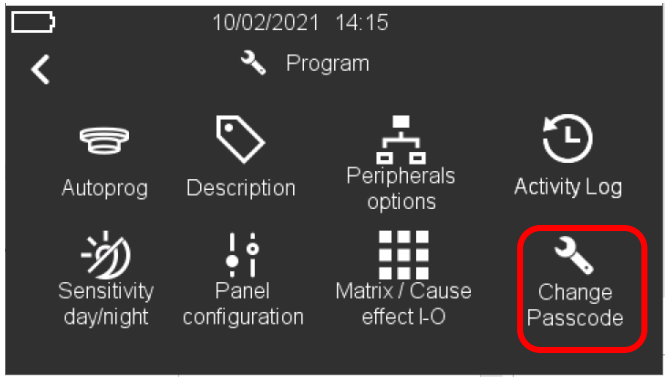

1. Select “Change Passcode” to change the Level 3 passcode.

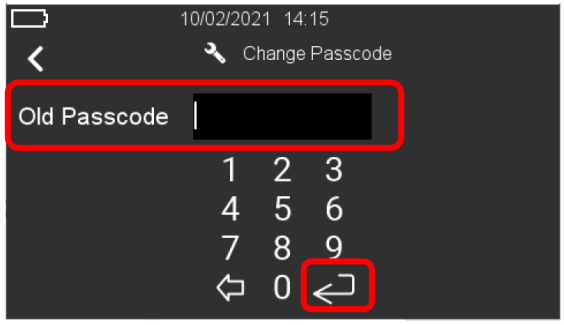

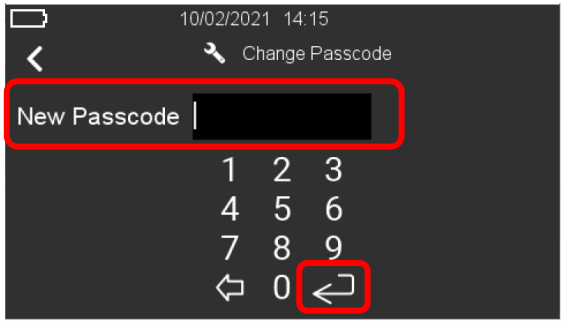

2. Insert the current Level 3 passcode and press the "enter" key.
3. In the next screen, insert the new 8-digit level 3 passcode, and press the "enter" key.

Default level 3 passcode (33333333) is not allowed as a new passcode.

4. Insert the same new level 3 passcode again in the following screen for confirmation. Press the "enter" key to confirm the new passcode.

14. OPERATION – ENABLE / DISABLE ZONE AND POINT

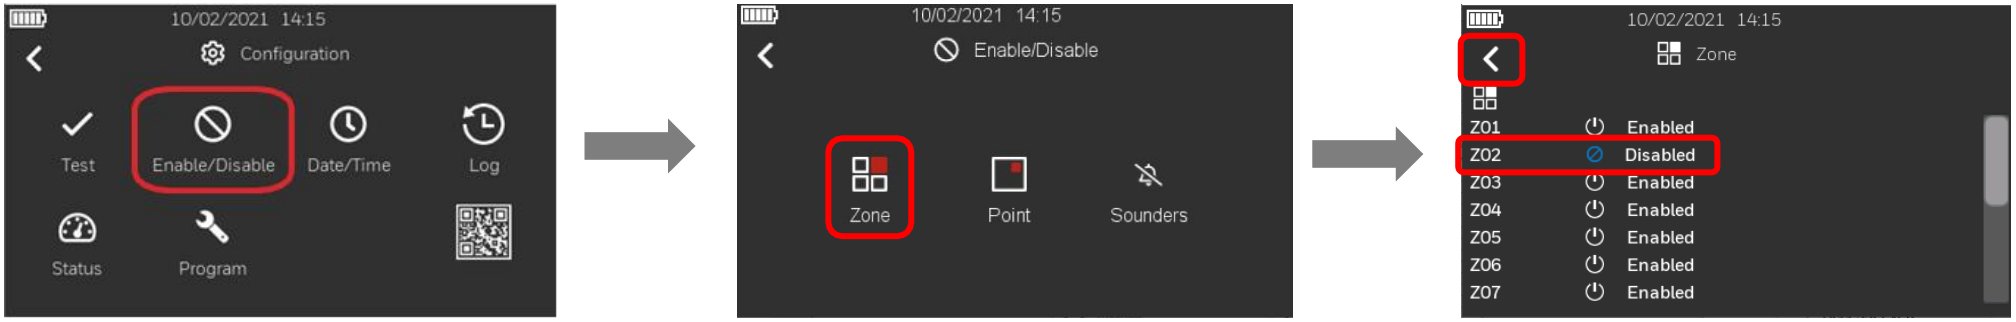

1. Follow the steps to enter in "Configuration" menu, select "Enable/Disable" icon to have access to Zone and Point options, then select Zone to view the list and then click on the icon near the Zone you would like to Disable to change its status. The Disabled icon appears near the selected Zone and status label will be updated (Enabled/Disabled), in this example Z02. Press the back arrow to go back to the main screen.

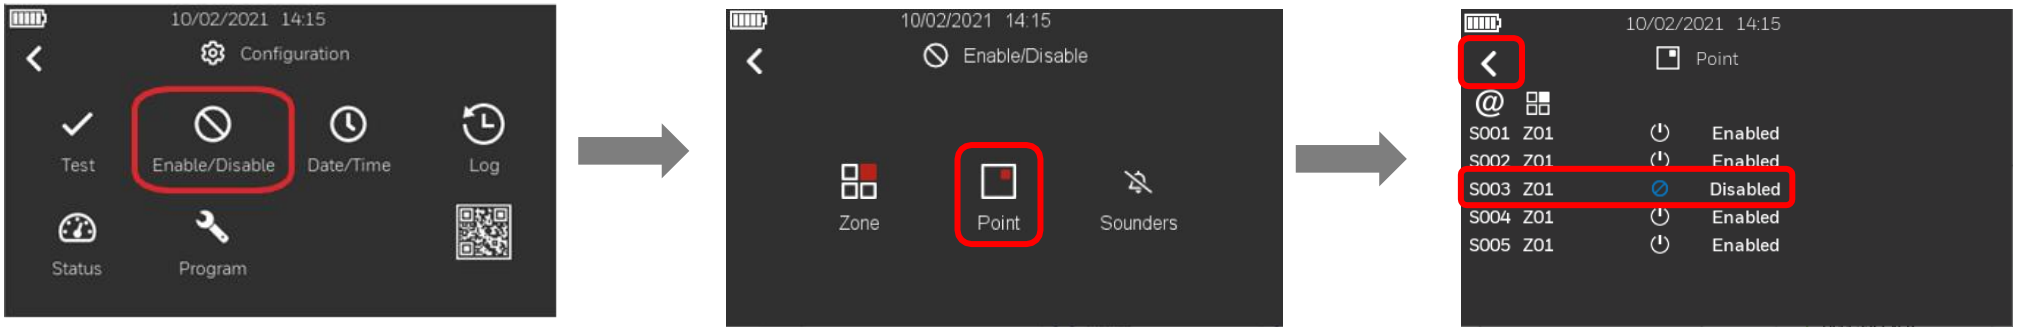

2. Same procedures apply to Disable a Point

3. To Enable a Zone or Point, follow the same steps: clicking on the related Disabled icon for the Zone or Point. The icon will change displaying the Enabled icon ., and status label will be updated to 'Enabled'. Press the back arrow to go back to the main screen.

15. OPERATION – ENABLE / DISABLE SOUNDERS

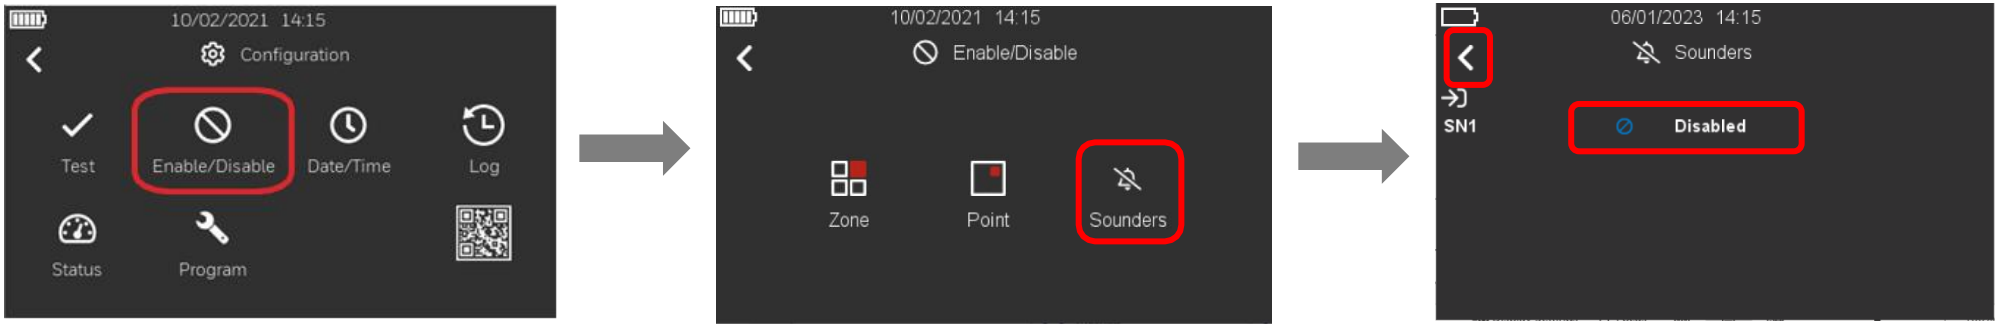

1. Follow the steps to enter in "Configuration" menu, select “Enable/Disable” icon to have access to Sounders option, then select Sounders to view the list and then click on the icon near the Sounder to Disable it. The Disabled icon appears near the selected Sounder and the status label will be updated, in this example SN1. Press the back arrow to go back to the main screen.
2. To Enable a Sounder again, follow the same steps: clicking on the related Disabled icon for the Sounder. The icon will change displaying the Enabled icon . Press the back arrow to go back to the main screen.

16. SYSTEM STATUS

16.1 System Status – Signal and Battery Levels for wireless devices

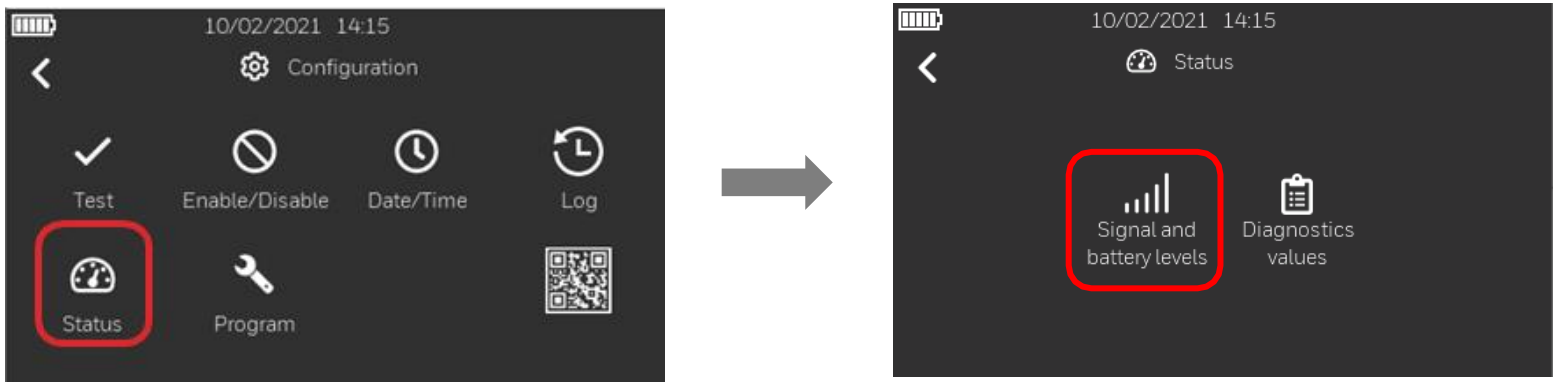

1. Follow the steps to enter “Configuration” menu, then select “Status", then press “Signal and battery levels”. If there are no wireless devices discovered on the loop(s), the “Signal and battery levels” option will be greyed out and cannot be selected.

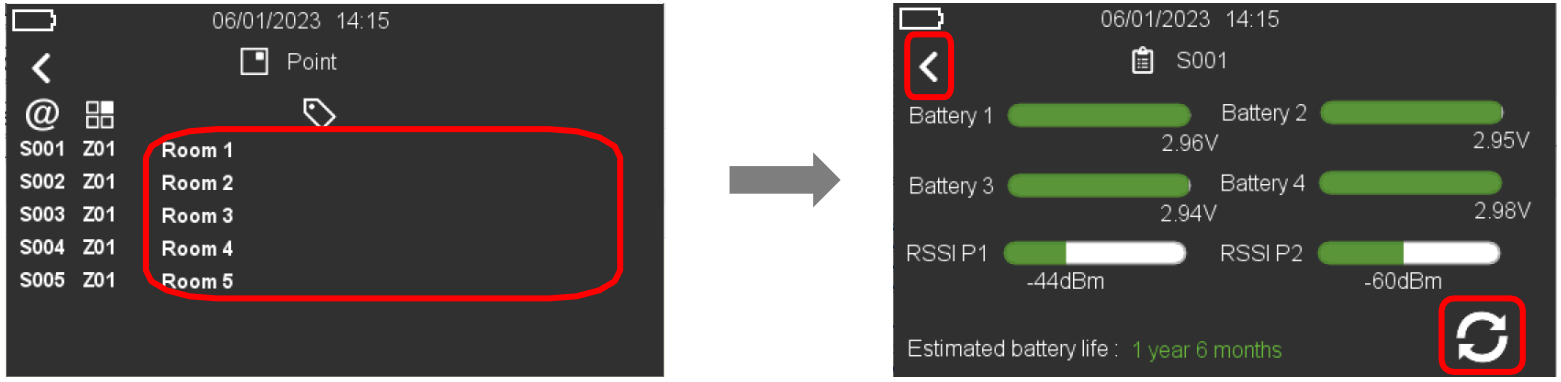

2. In the next screen, you can view a list of wireless devices. To view the status of a particular wireless device, press at the right side of the device number (e.g., S001) below the icon . You can see the voltage levels of 4 batteries, RSSI levels of Parent 1 and Parent 2 nodes and the estimated remaining battery life. Press the refresh button to fetch the values again. Press the back arrow to go back to the previous screen.

Note:

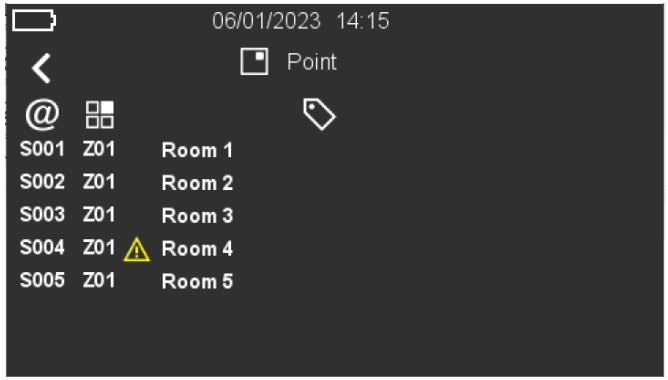

⚠ indication for a wireless device (S004 in this example) indicates that the voltage level of at least one of its 4 batteries, has fallen to 2.7V or below.

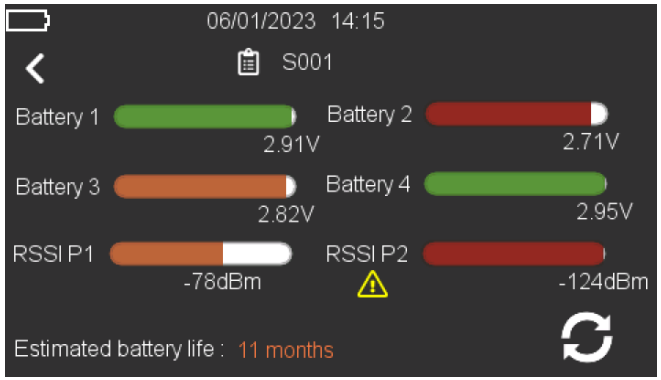

Different colors are used to indicate good, warning and fault levels.

Battery

	Indicates good levels	above 2.85V
	Indicates warning levels	above 2.71V upto 2.85V
	Indicates fault levels	2.71V or below

Signal

	Indicates good link quality	RSSI is between -30dBm to -74dBm
	Indicates medium link quality	RSSI is up to -30dBm OR RSSI is between -74dBm to -84dBm
	Indicates bad link quality	RSSI less than -84dBm
⚠	Indicates bad link quality	Comm loss/error rate > 40%

Estimated remaining battery life

	More than 12 months of remaining battery life
	More than 6 but up to 12 months of remaining battery life
	6 months or less remaining battery life

16.2 System Status – Panel Diagnostics Values

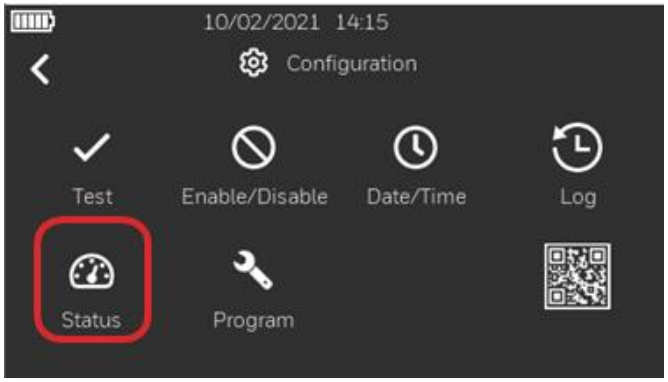

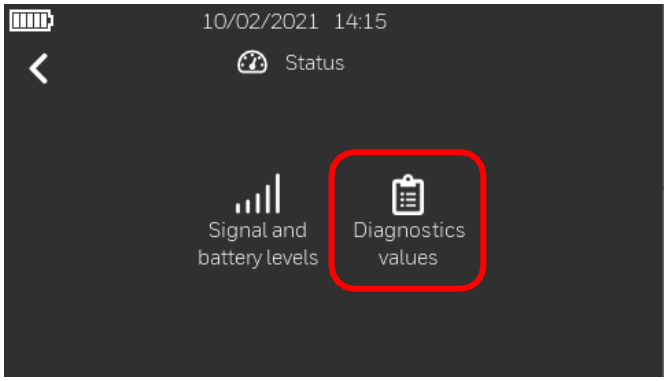

1. Follow the steps to enter in “Configuration” menu, then select “Status" then press “Diagnostic values”.

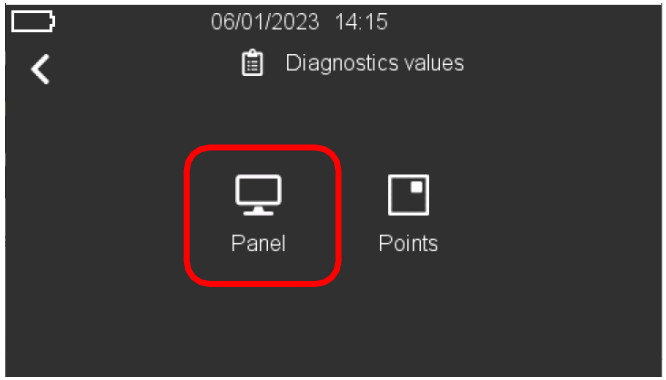

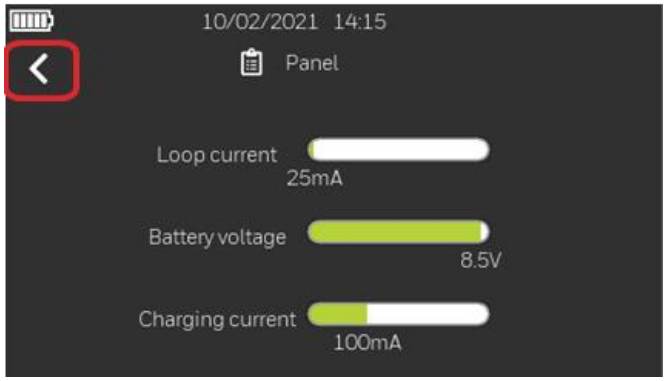

2. Select “Panel” to see current system status: loop current absorbed by the wired field devices, the battery voltage, and the charging current. Press the back arrow to go back to the main screen.

16.3 System Status – Points Diagnostics Values

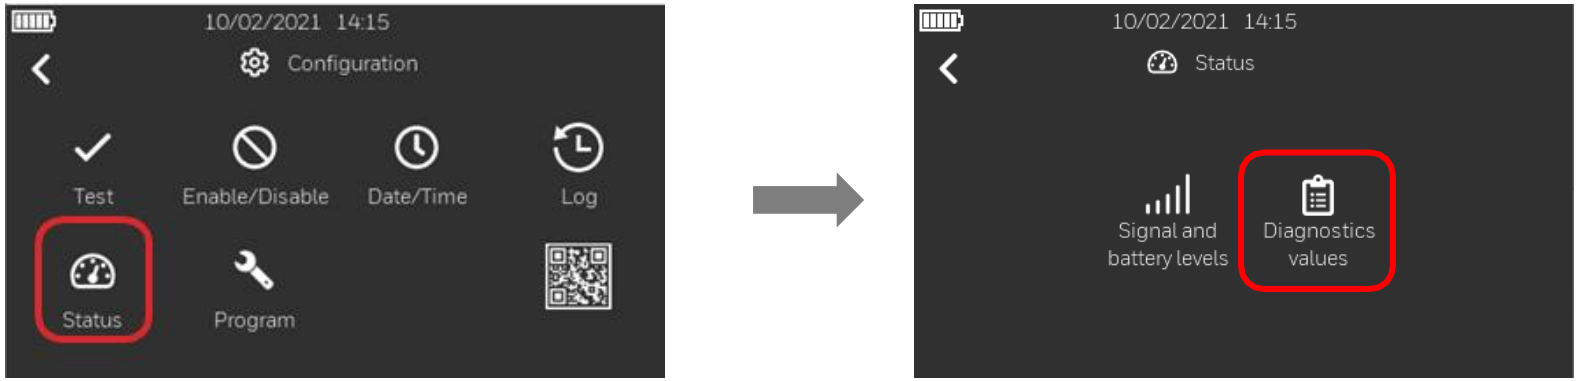

1. Follow the steps to enter in “Configuration” menu, select “Status" then press “Diagnostic values”.

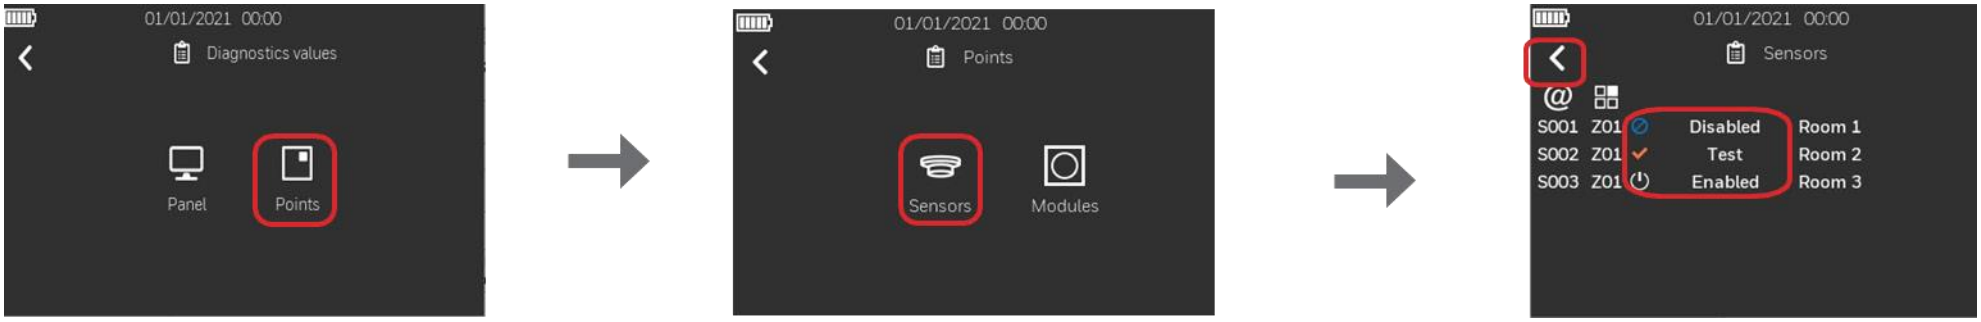

2. Select “Points” to move to the next screen where you can select “Sensors” or “Modules” list. In this example, we will select Sensors to see the status represented by the relevant icons. Press the back arrow to go back to the main screen.

17. HISTORY LOG

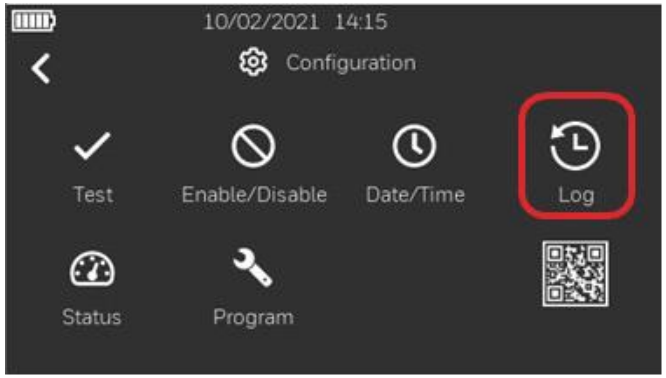

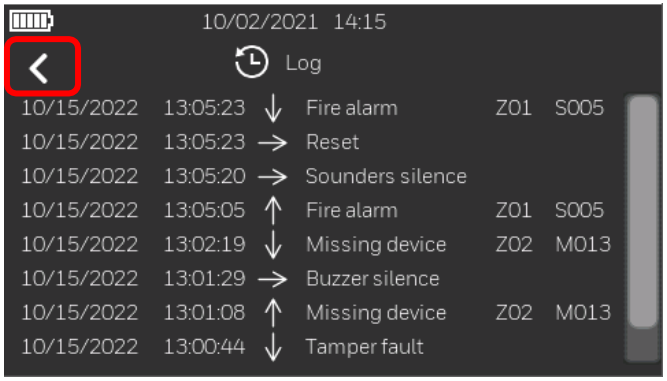

1. Follow the steps to enter in “Configuration” menu, then select “Log”.
2. The events are shared in sequence, the latest is on top and the oldest is on the bottom of the list. Are shown date and time of the events, the type of the events, the Zone number and the related device address. Are also shown the commands released from the panel.

   The arrows indicates:
   - ↑ an event has started
   - ↓ an event is finished
   - → a command from the panel was released.
3. Press the back arrow to go back to the main screen.

18. SYSTEM TEST

18.1 System Test – User Interface and Relay

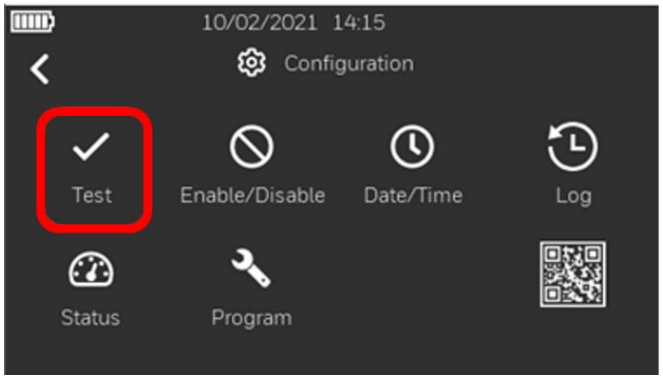

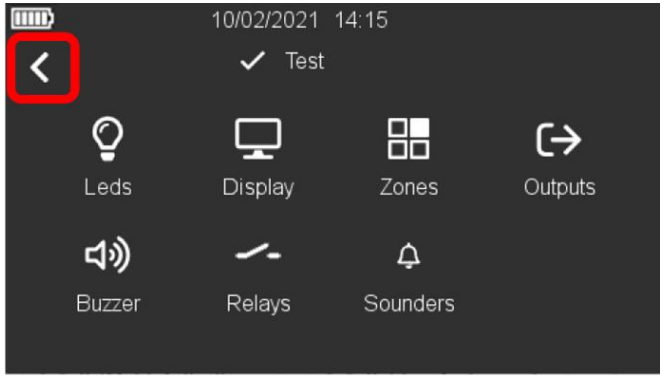

1. Follow the steps to enter in “Configuration” menu and select “Test" to access the available test options.
2. Selecting the following icons, you will have:

Leds	**LED**	All front panel LED become steady for 3 second and then automatically come back to the previous condition
Display	**DISPLAY**	The display change color dynamically and then come back to the menu
Buzzer	**BUZZER**	The buzzer sounds for 3 second and then turn off automatically
Relays	**RELAY**	The alarm and trouble relays get activated for 3 second and then gets deactivated automatically

3. Press the back arrow to go back to the previous screen.

18.2 System Test – Zones

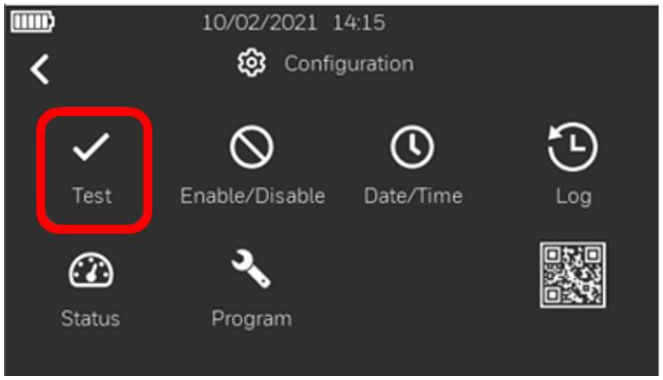

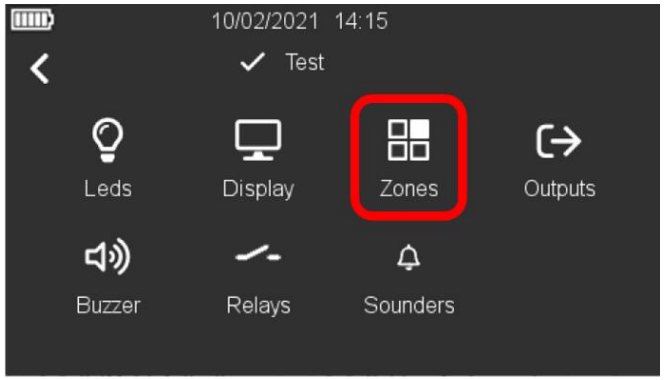

1. Follow the steps to enter in “Configuration” menu, select “Test" to access to the related options, then select “Zones” icon to view the Zone list.

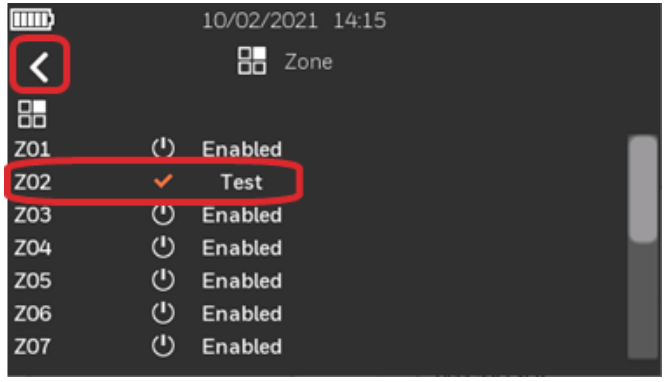

2. Click on the icon near the Zone you would like to put in Test. The Test icon will be displayed near the selected Zone and status label will be updated; in this example Z02.
   Press the back arrow for go back to the previous screen.
3. To end the Test, click on the related Test icon of the Zone in test. The Enabled icon will be displayed near the Zone and status label will be updated.
   Press the back arrow to go back to the previous screen.

18.3 System Test – Outputs

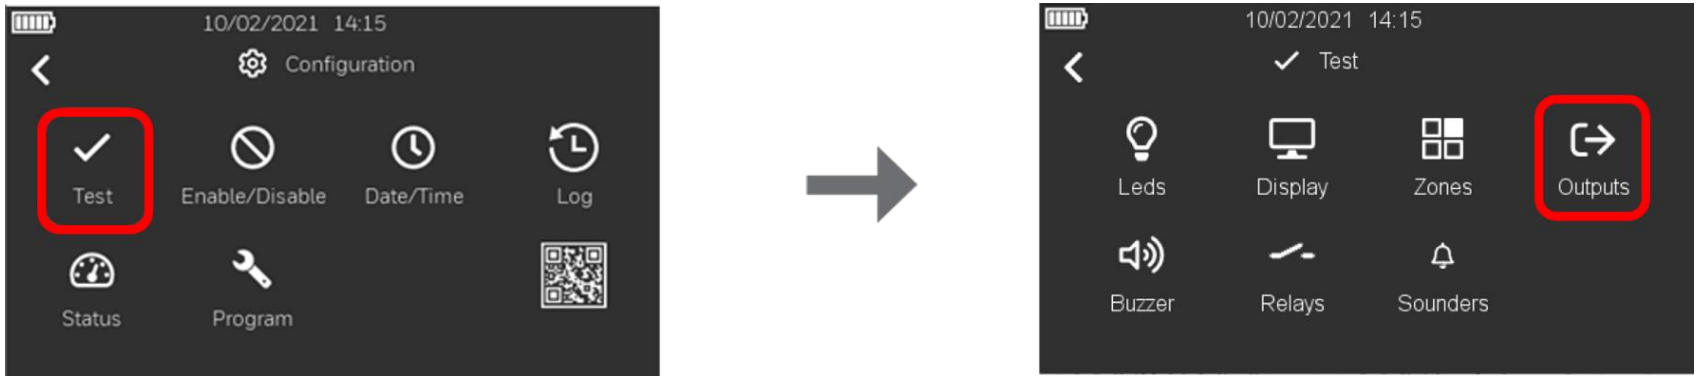

1. Follow the steps to enter in “Configuration” menu, select “Test" to access the available test options, then select “Outputs” icon to view the list of the addressable Outputs installed in the system.

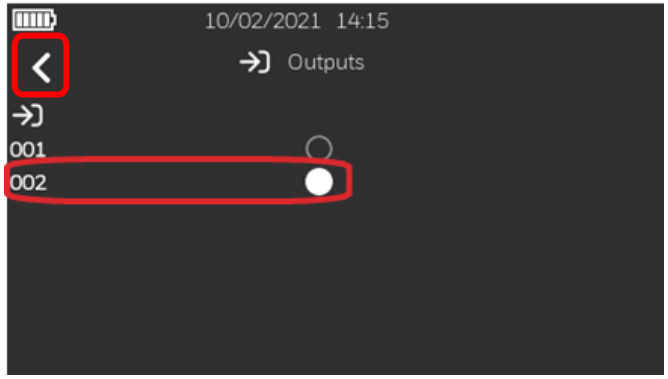

2. Click on the empty circle near the output you would like to activate it. In this example, we are activating the Output with address 002.

3. To end the Output test, press on the full dot so the dot next to the desired output device appears empty. Press the back arrow to go back to the previous screen.

18.4 System Test – Sounders

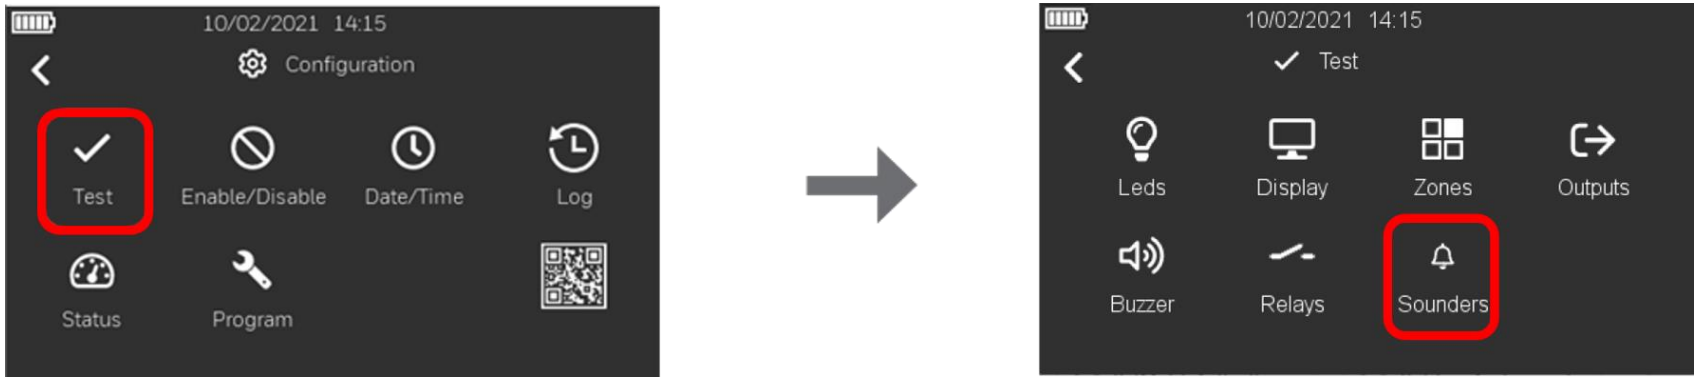

1. Follow the steps 1 and 2 to enter in “Configuration” menu, select “Test" to access the available test options, then select “Sounders” icon to view the list of the panel outputs (on-board Sounder Circuits).

2. Click on the empty circle near the Sounder you would like to activate it. In this example, we are activating the sounder circuit 1 (SN1).
3. To end the Sounder test, press on the full dot, so that the dot next to the desired sounder circuit appears empty. Press the back arrow to go back to the previous screen.

19. MAINTENANCE

A logbook should be used for recording day to day events in the system, it should be used to record service and maintenance work visits.

ROUTINE TESTING

To ensure that the system is fully operational it must be routinely tested in accordance with the requirements of EN 54-14, national code of practice and local requirements.

BATTERIES

As a minimum, replace the panel batteries that provides power to the system every four years. The battery units must always be disposed of in accordance with the battery manufacturer's recommendations and local regulations. Please replace the batteries for equivalent ones otherwise the standby requirement will not be meet.

FAULT MONITORING AND RECTIFICATION

Where there is an active fault in the system, which is displayed at the panel, then this fault can be interrogated by a trained person. To assist in decision making as to the cause and solution, see section headed Messages and their meaning.

CLEANING

The panel case may be cleaned periodically by wiping with a soft, damp lint-free cloth. Do not use any solvents. Before cleaning the touch screen ensure the panel is at access level 1 and take care to use a clean cloth to clean the touch screen.

20. UPGRADING PANEL FIRMWARE

Over the course of a fire alarm panel's life, it becomes necessary to upgrade the panel's firmware for various reasons, whether this be due to essential life safety maintenance or feature enhancements. Morley-IAS Lite allows users a simple way to upgrade. Below are the necessary steps required to successfully upgrade the panel firmware.

You will require: Windows™ PC *with internet access, USB A to B lead. – *Internet access required for firmware and driver files download only.

1. Download the latest firmware version from the Morley-IAS Lite technical website: https://buildings.honeywell.com/gb/en/lp/morleytech. Please ensure you select the appropriate firmware for your specific model of control panel. Once the firmware file is downloaded, extract/uncompress the compressed folder.

2. Also, download the DFU Driver for STM32 from the same Morley-IAS Lite technical website. Once the driver file is downloaded, extract/uncompress the compressed folder and install the DFU driver by double clicking on the installer.exe file according to your PC system type.

3. Power OFF the panel by removing the mains supply and disconnect the backup batteries. Please ensure the front cover ribbon cable is still firmly connected.

4. Connect the USB cable from the PC to the USB B port.

5. Press and hold both the Reset Panel and Mute Buzzer buttons on the front cover while returning the mains supply. Keep both buttons pressed for approximately 5 seconds. After 5 seconds, the panel will enter the bootloader mode. Once in bootloader mode, identified by the continuous buzzer sound and the blank display, release the buttons.

6. Ensure all below files are present in the extracted/uncompressed folder. Double click on FlashFirmware_STM_LT_32.bat (for LT-32) or FlashFirmware_STM_LT_159.bat (for LT-159) to start the firmware update.

LT-32

- dfu-util.exe
- FlashFirmware_STM_LT_32.bat
- libusb-1.0.dll
- MMSLT32_Enc.bin

LT-159

- dfu-util.exe
- FlashFirmware_STM_LT_159.bat
- libusb-1.0.dll
- MMSLT159_Enc.bin

Please note: It is crucial to NOT remove power to the panel during this process, as it may lead to an incomplete update and potential system failure.

7. The firmware update will start in a command window, as below. Progress of the firmware update is indicated at the bottom, as shown.

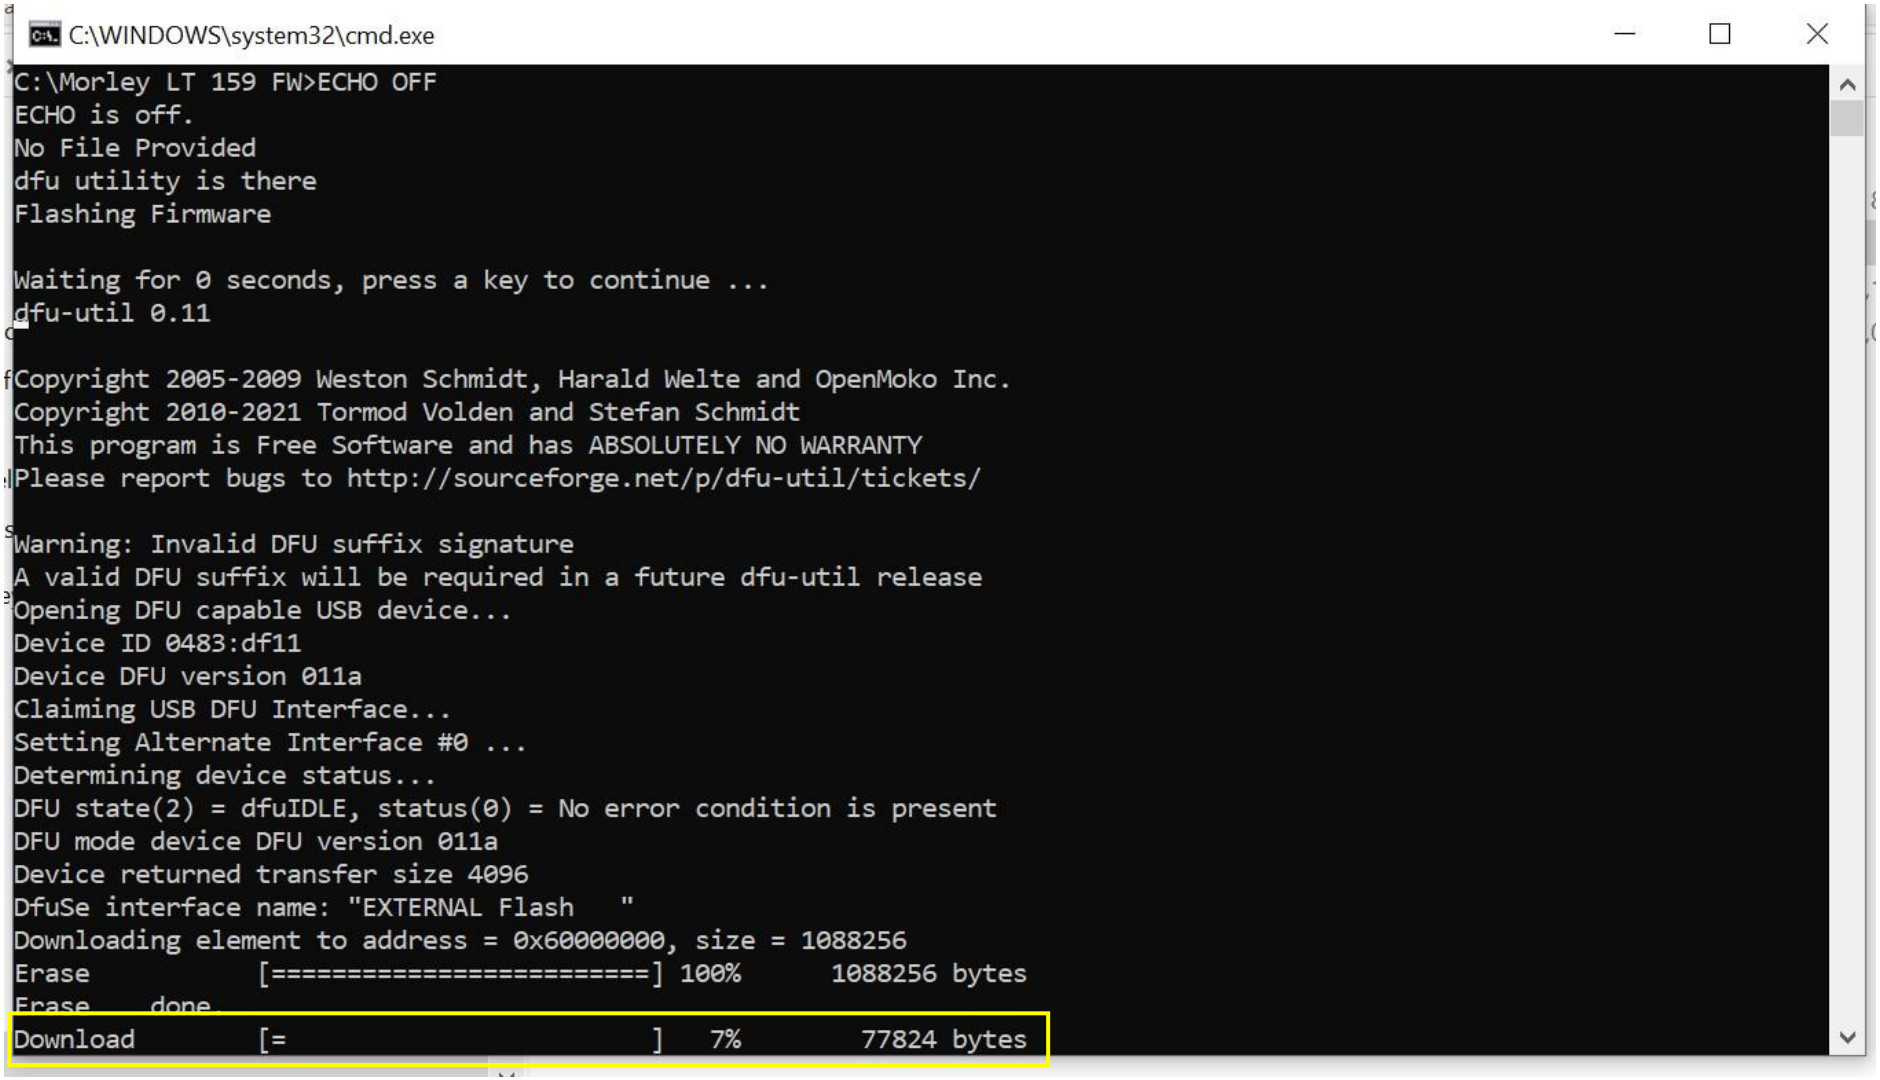

8. Once the upload is complete, successful update message will appear and the command window closes automatically. The panel will continue to be in the same state (continuous buzzer sound and the blank display) for about 1 more minute, in order to complete the update process.

9. After completion, the panel will automatically reboot displaying the Honeywell Morley-IAS logo.

10. After the panel boots, the second stage i.e. the loop firmware update will start. Progress of the update is indicated on the screen, as shown.

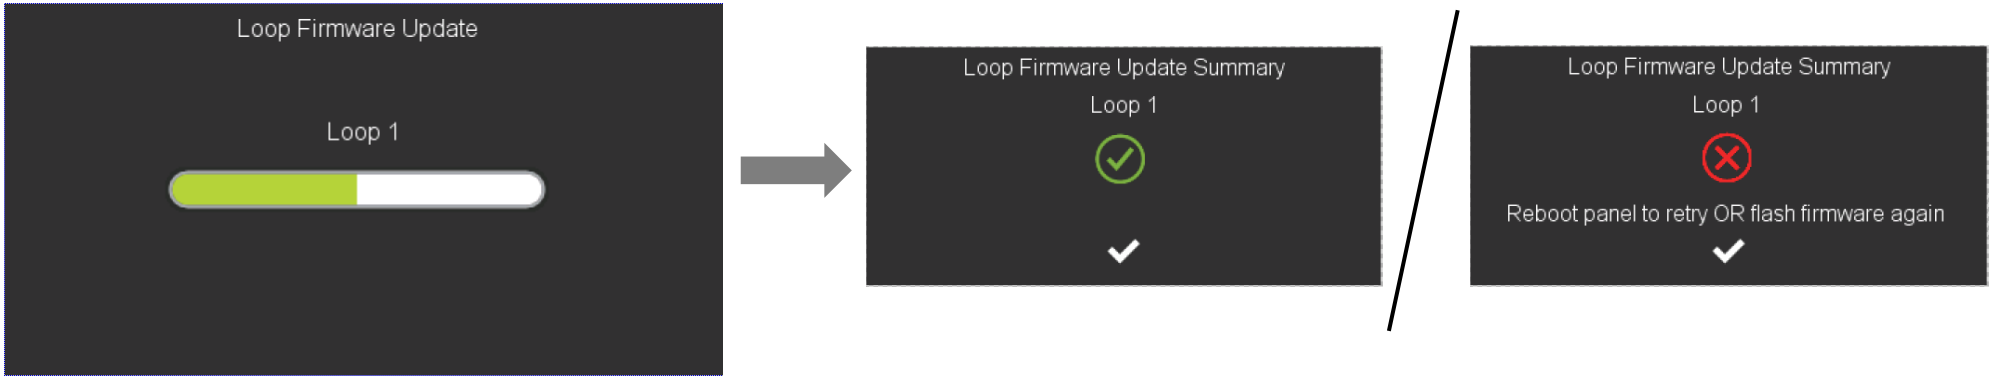

11. Once complete, the Loop Firmware Update Summary will indicate a successful update. If the Loop Firmware Update fails, reboot the panel to retry only the loop firmware update OR repeat the entire firmware update process from Step 3 onwards.

12. Press the check mark ✔ to close the Loop Firmware Update Summary. The panel is now operational.

13. Go to the Panel Configuration menu and verify the firmware version of the panel.

14. Next the Date and Time MUST be re-entered. Go to Date/Time menu and set the correct date and time.

Congratulations, by successfully following the steps above, you now have updated the Morley-IAS LT-32/ LT-159 panel firmware.

21. PRODUCT LIST

Lite 1 Closed Loop Panel Advanced Protocol
up to 32 devices
Morley-IAS LT-32

Lite 1 Closed Loop Panel Advanced Protocol
up to 159 devices
Morley-IAS LT-159

21.1 Compatible Devices

Detectors	Detectors	Manual Call Points	I/O Modules	AV Devices	Wireless Devices
MI-PSE-S2	MI-LZR-S3I	MI-MCP-FLEX	MI/D240CMOE	MI-BGL-PC-I	MI-GATE
MI-PSE-S2I	MI-OSI-RIE	MI-MCP-FLEX/C	MI/D2ICMOE	MI-BRH-PC-I	22051E-RF
MI-PSE-S2-IV	HM-PSE-I	MI-MCP-FLEX-I	MI/DMM2IE	MI-BRS-PC-I	22051TLE-RF
MI-PTIR-S2	HM-PSE-S2	MI-MCP-FLEX-I/C	MI/DCMOE	MI-BSO-DD-I	52051E-RF
MI-PTIR-S2I	HM-PSE-S2-I	MI-MCP-GLASS	MI/DMMIE	MI-BSO-DD-N	52051RE-RF
MI-PTIR-S2-IV	HM-PTSE	MI-MCP-GLASS-I	MI-D240CMOE	MI-BSO-PP-I	M200F-RF
MI-PTSE-S2	HM-PTSE-I	MI-WCP-R/I/SG	MI-DMMIE	MI-BSO-PP-N	M211E-RF
MI-PTSE-S2I	HM-RHSE	MI-WCP-R/I/SG/C	MI-D2ICMOE	MI-DSS-PC-I	R5A-RF
MI-PTSE-S2-IV	HM-RHSE-I	MI-WCP-R/SG	MI-DMM2IE	MI-DSS-PC-N	M200I-RF
MI-FHSE-S2	HM-FHSE	MI-WCP-R/SF	MI-DCMOE	MI-WSO-PP-I	WSO-RR-RF
MI-FHSE-S2I	HM-FHSE-I	MI-WCP-R/I/SF/C	MI-MM3E-S2	MI-WSO-PP-N	WSO-WW-RF
MI-FHSE-S2-IV	HM-PSE	HM-MCP-GLASS-AP	MI-IM10-S2I	MI-WSO-PR-I	WSF-RR-RF
MI-HTSE-S2	HM-PSE-AP		MI-CR6-S2I	MI-WSO-PR-N	WSF-WR-RF
MI-HTSE-S2I	HM-PTSE-AP			MI-WSS-PC-I	
MI-HTSE-S2-IV	HM-PSE-I-AP			MI-WSS-PC-N	
MI-RHSE-S2	HM-PTSE-I-AP			MI-WSS-PR-I	
MI-RHSE-S2I	HM-RHSE-AP			MI-WSS-PR-N	
MI-RHSE-S2-IV	HM-RHSE-I-AP			MI-WST-PC-I	
	HM-FHSE-AP			MI-WST-PC-N	
	HM-FHSE-I-AP			MI-WST-PR-I	
				MI-WST-PR-N	
				WRL-PC-I05	

Detectors	Detectors	Manual Call Points	I/O Modules	AV Devices	Wireless Devices
				WRL-RC-I05 WWL-PC-I05 WWL-RC-I05 WRA-PC-I05 WRA-RC-I05 WWA-PC-I05 WWA-RC-I05	

Notes

Notes

Honeywell House
Skimped Hill Lane
BRACKNELL
Berkshire, RG12 1EB
UK

M-168.1-SERIE_LT-EN Version 2024 / 06.2024
Technical changes reserved!
© 2024 Honeywell International Inc.